

FIJI ELECTRICITY AUTHORITY



TENDER SPECIFICATIONS

TENDER

TENDER NO: MR 143/2017

**Maintenance of Fuel Supply Line and Tank Base at Rokobili Power
Station**

Scope of Work – Maintenance of Fuel Supply Line, Tank and Tank Base at Rokobili Power Station

Fiji Electricity Authority invites potential bidders to bid for the maintenance and rust management for the fuel supply line at Rokobili Power Station.

The fuel supply line, its braces and the steps providing access to the Industrial Diesel Oil (IDO) needs mending and a double coat finishing to be applied.

Scope Details

The contractor shall accomplish all work to carry out rust management and double coat finishing of the amenities which includes the fuel line, its braces and steps for the Rokobili Power Station Industrial Diesel Oil (IDO) storage tank.


1. The contractor shall carry out rust management to eliminate all the existing rust on the fuel line. The braces of this fuel pipe line and the steps to access the IDO fuel tank shall also be treated.
2. The contractor shall apply rust guards on all the pipes including the fuel line, its braces and the steps to access IDO storage tank.
3. The contractor shall apply double coat finishing on all the amenities stated to provide additional durability. This shall be according to FEA colour code.

Note:

- The bidder shall provide information in the similar types of works.
- The quotes shall include materials and furnish details of special tools/equipment required for maintenance of the fuel supply line, tank and tank base.
- All materials and consumables must be self-supplied and materials not supplied must be clearly stated.
- All removed materials to be left at Rokobili Power Station.
- **Site inspection is mandatory!**

Appendix

Figures below shows the storage tank, access stairway and tank base.

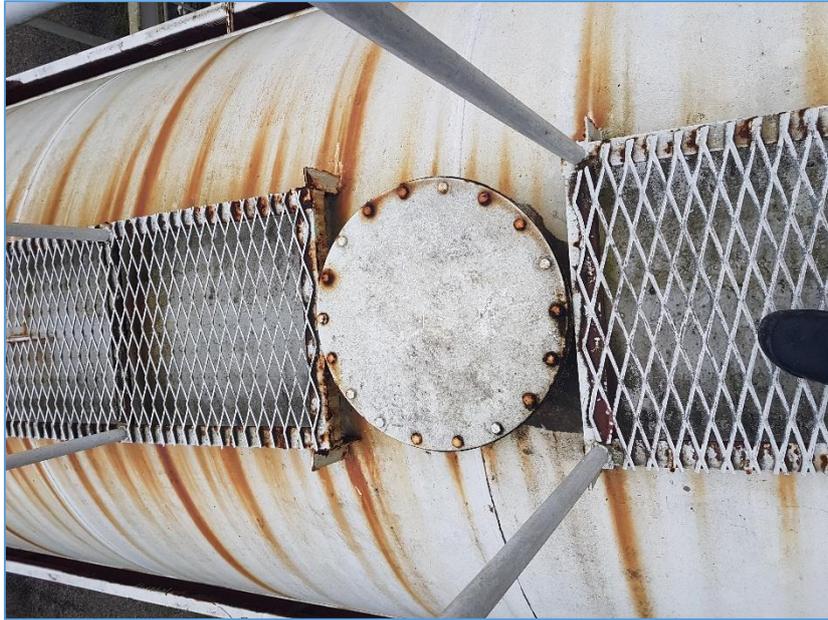



Maintenance of Fuel Supply line, Tank and Tank Base at Rokobili Power Station

Item	ITEM DESCRIPTION	UNIT PRICE	TOTAL PRICE
1	Materials cost		
2	Labor cost		
	TOTAL (VEP)		
	VAT 9%		
	TOTAL (VIP)		

Notes:

1. All Sub-contractors to be used for any part of the works are to be declared.
2. FEA financial terms are applicable for these works.
3. Site inspection is mandatory.
5. Contractor shall abide by all local and statutory laws and requirements, such as OHS etc.
6. The site shall be left in a neat and tidy condition after the completion of the works.
7. Contractor to provide timeline for project completion

Submission of Tender

Two (2) hard copies of the tender bids in sealed envelope shall be deposited in the tender box located at the Supply Chain Office at the FEA Head Office, 2 Marlow Street, Suva, Fiji.

Courier charges for delivery of Tender Document must be paid by the bidders.

This tender closes at 4:00 p.m. (16.00hrs Fiji time) on Wednesday 12th July, 2017

Site Visit: FEA's Rokobili Power Station at 11.00 am on Wednesday 28th June, 2017

Each tender shall be sealed in an envelope with:

The envelope bearing only the following marking:

TENDER No. MR 143/2017

Maintenance of Fuel Supply Line and Tank Base at FEA's Rokobili Power Station

The Secretary, Tender Committee
Fiji Electricity Authority
Supply Chain Office
Private Mail Bag, Suva

It must also indicate the name and address of the tenderer on the reverse of the envelope.

All late tenders, unmarked Envelopes and envelopes without bidder's name and address on the reverse on the envelope will be returned to the Tenderers unopened. (Bids via e-mail or fax will not be considered).

The bidders must ensure that their bid is inclusive of all Taxes payable under Fiji Income Tax Act and must have the most current Tax Compliance Certificate.

For further information or clarification please contact our Supply Chain Office on phone **(+679) 3224360 or (+679) 9991587.**