


Swampy are to be be digged out and filled with recommended hard fill

Note:
 No. of generator set - 10
 No. of Transformer - 5
 Generator Details - 1MW, 415V, 50Hz
 Transformer Details - .415 / 33kV, Ynd11, ONAN
 Gap between two gen sets is 3000mm.
 Gap between two transformer is 8800mm.

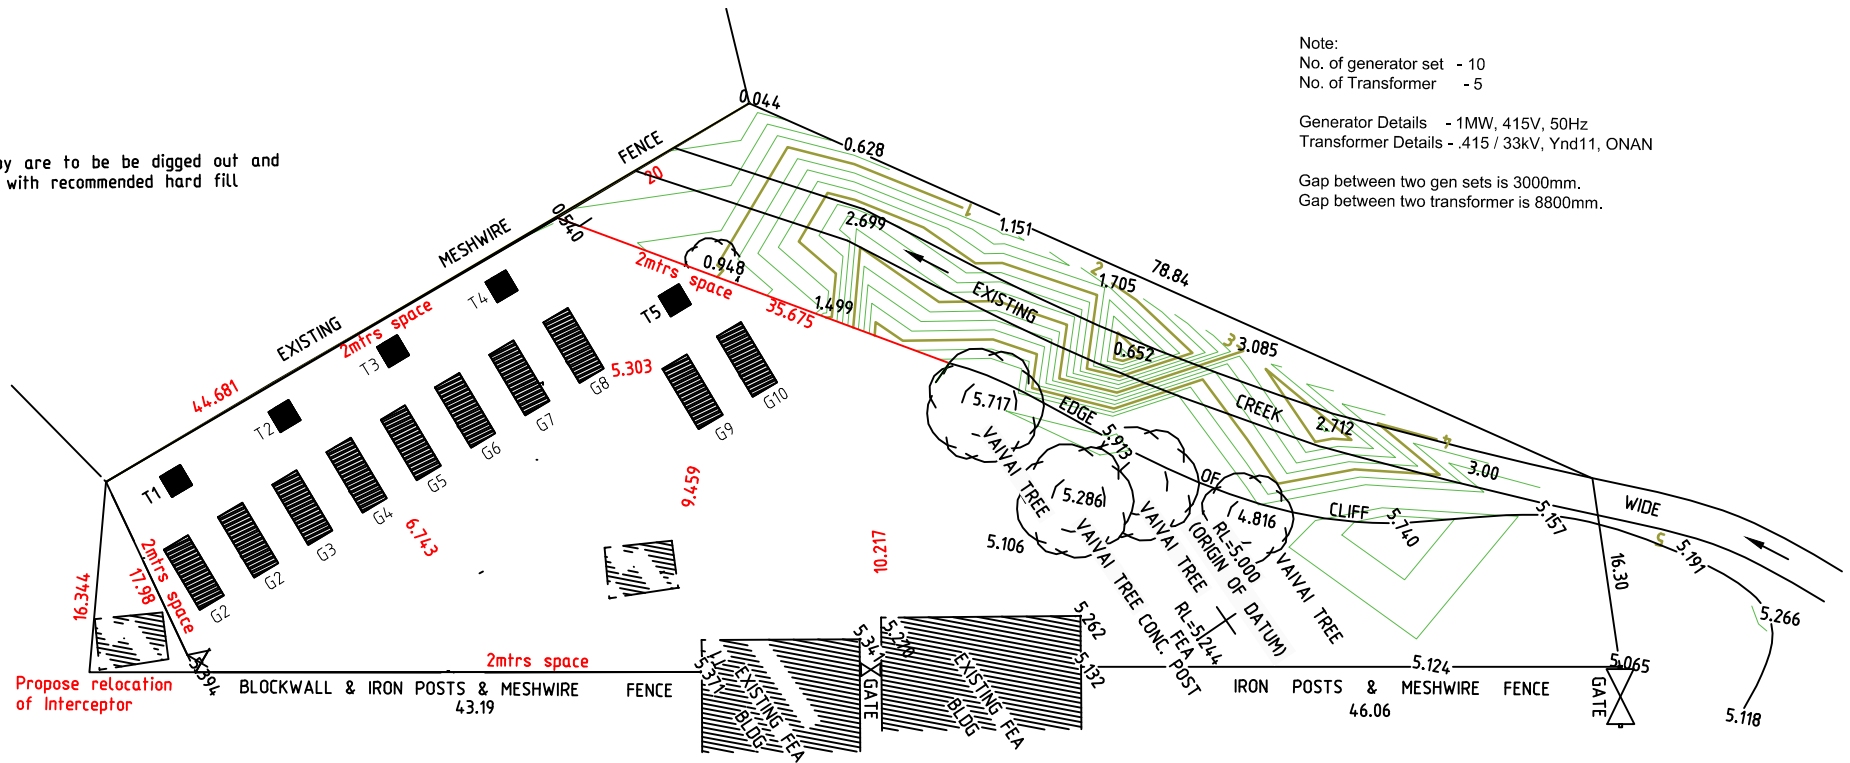

Propose relocation of Interceptor

EXISTING SITE TOPOGRAPHICAL SURVEY PLAN
 SCALE 1 : 400

(121.69)

NOTES

1. ALL SWAMPY AREA MARKED A TO BE REMOVED FOR LAND FILLING
2. ALL TREES ON SITE TO BE REMOVED WITH ROOTS
3. FILL EXISTING CREEK TO REQUIRED LOCATED AND DIVERT DRAIN TO NEW LOCATION AS SHOWN.
4. EXISTING CONCRETE STEPS AND OIL PIT WITH SHED TO BE DEMOLISHED AND REBUILT WITH NEW STRUCTURE TO NEW PROVIDED LOCATION BY FEA.