


## 2.3 Type designation

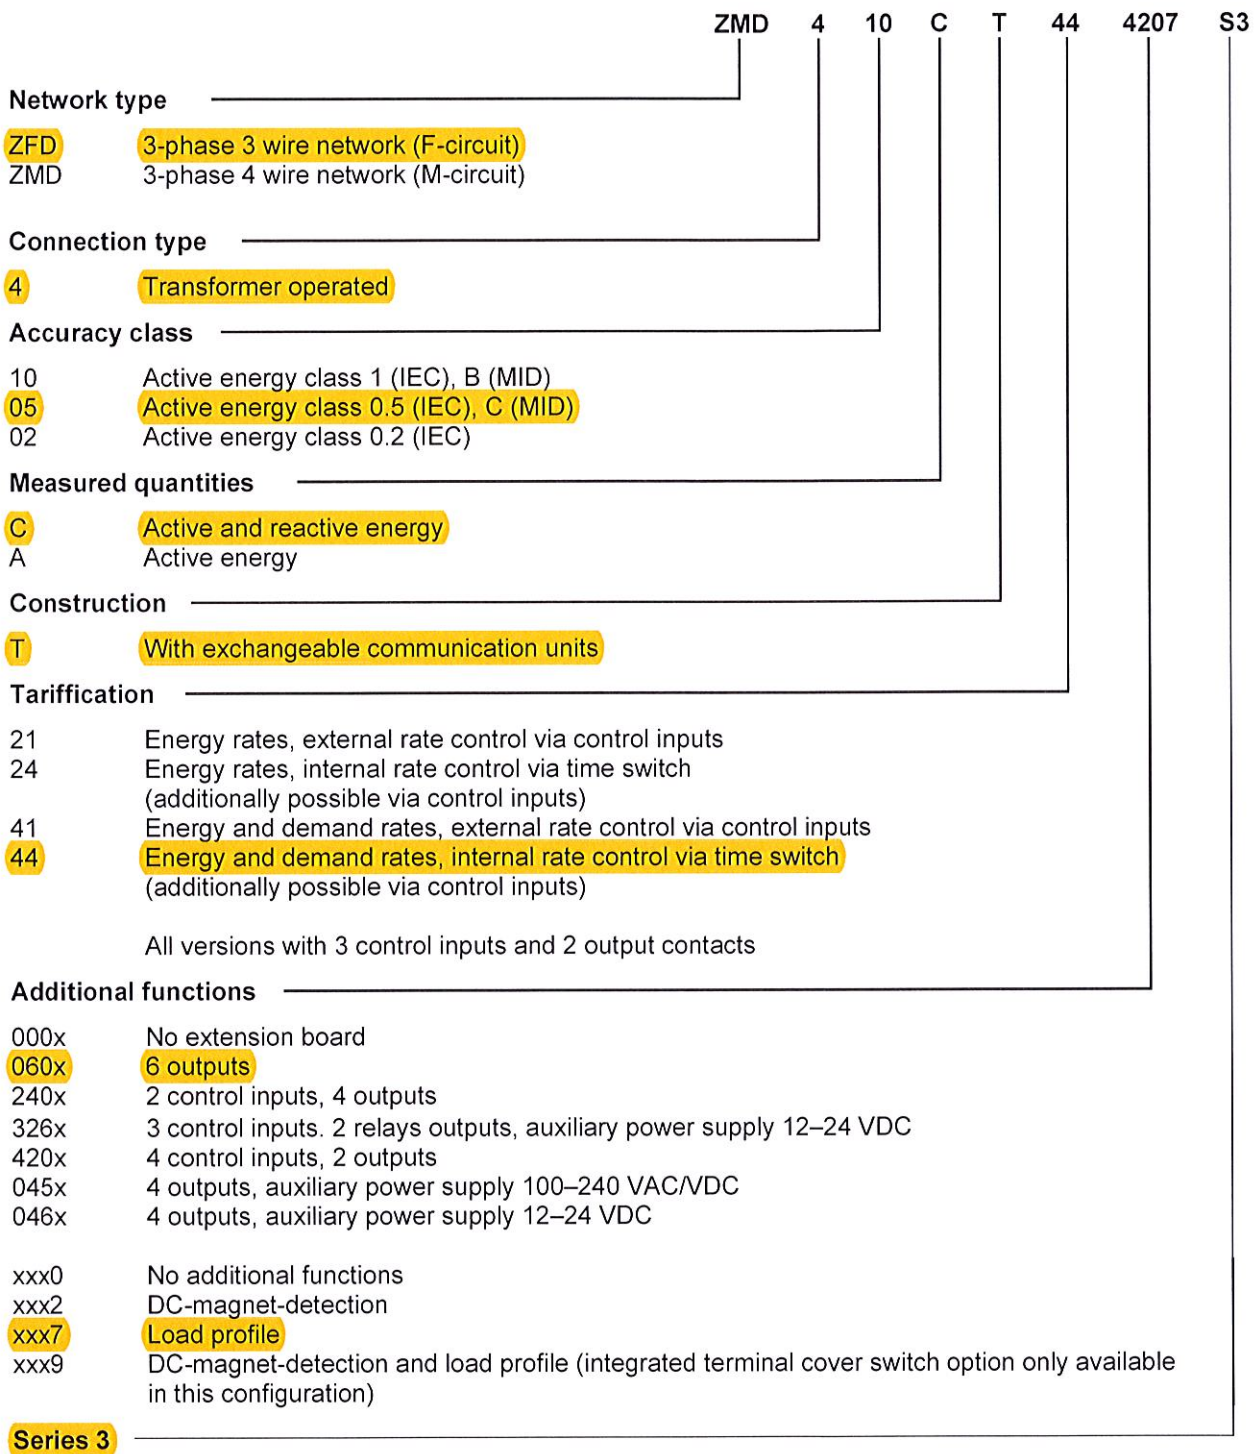

As the communication unit is a device on its own, it is not part of the meter's type designation. The customer can exchange it at any time without opening the certification seal. Each communication unit has its own user manual.

### Series designation

The hardware version is defined with a series designation. The first hardware generation (Series 1) does not have a series designation.

The type designation on the nameplate ends with the series designation S2 for the 2nd hardware generation (Series 2). An attached suffix points out