


## Proposal Redundant 33kV Tie Between Tanugamanono Power Station and Fuluasou Substation

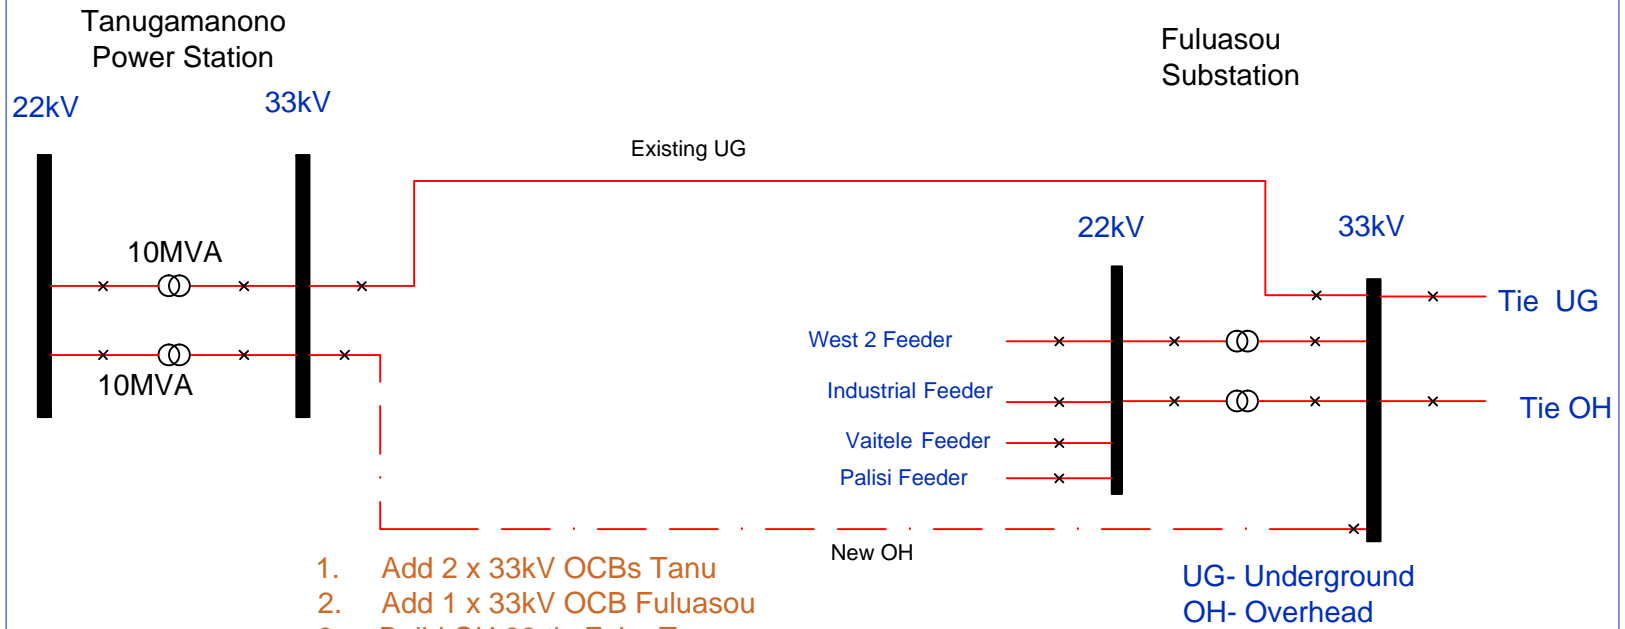

1. Add 2 x 33kV OCBs Tanu
2. Add 1 x 33kV OCB Fuluasou
3. Build OH 33 tie Fulu- Tanu
4. Buy 1 x 10MVA 22/33 Xmer at Tanu
5. Add 1 x 22kV OCB at Tanu 22kW Switchgear