


MARSHALLS ENERGY CO, INC.
PO BOX 1439
MAJURO, MH 96960

TRANSMISSION & DISTRIBUTION SPECIFICATION

SPECIFICATION NO.: MEC-Dist-Cable-20

FOR

PRIMARY UNDERGROUND CABLE
15kV

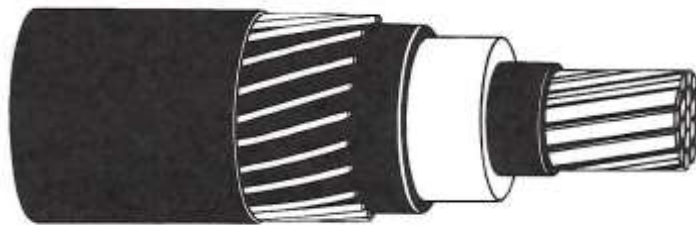

Revision	Date	Reviewed	Approved
One	Feb 2020	SJW	S Wakefield

PRIMARY UNDERGROUND WIRE 15kV

TABLE OF CONTENTS

SECTION		PAGE
1.0	Scope	3
2.0	Application Publication	3
3.0	Deviation and Non-Conformance Requirements	3
4.0	Submittals	4
5.0	Certified Laboratory Tests	4
6.0	Design and Construction	4
7.0	Quality Control	6
8.0	Packing and Shipping	7
9.0	Table A	8

PRIMARY UNDERGROUND WIRE 15kV

1. SCOPE

- 1.1. This specification covers primary underground conductors rated at 15,000 volts.
- 1.2. The cable shall be suitable for use in wet and dry locations in the underground medium voltage distribution system of the Marshalls Energy Co, Inc.
- 1.3. The cable shall be operated at normal conductor temperatures not exceeding 90°C. The emergency rating shall be 130°C for periods which shall not exceed 100 hours per year. For the life of the wire, there shall be no more than five occurrences of 100-hour overload periods.

2. APPLICABLE PUBLICATION

- 2.1. The cables shall meet the requirements of NEMA Standard Publication for Wire and Cable for the Transmission and Distribution of Electrical Energy.
- 2.2. Except as specified herein, the cables shall meet or exceed requirements of all applicable industry conductor, insulation and cable standards and specifications, i.e., ANSI, ASTM, EEI, IPCEA, NEMA and Underwriter's Laboratory.

3. DEVIATIONS AND NON-CONFORMANCE REQUIREMENTS

- 3.1. Deviations from this specification or changes in the material or design after the purchase order has been placed must be approved by the MEC Technical department and acknowledged by a Purchase Order Amendment issued by MEC.
- 3.2. Units received with deviations or non-conformances that are not acknowledged per Section 3.1 are subject to rejection. The Supplier of rejected units is responsible for any corrective action including but not limited to materials, labor and transportation necessary to dispose of or make the units conform to the specification.

3.3. Notification of defective units discovered before or after installation that are believed to be inherent to manufacturing problems or workmanship shall be made and forwarded to the Supplier. The description of the item, documentation of the problem and the described information, disposition and/or follow-up (as appropriate) that MEC expects from the Supplier will be specified. The Supplier's response shall be made within thirty (30) days unless an extension is acknowledged and approved in writing by the MEC Procurement Manager.

4. SUBMITTALS

- 4.1. Shop drawings and product data sheets indicating details of construction shall be submitted to MEC Procurement Manager for review and approval.
- 4.2. MEC shall be allowed two (2) weeks to review and approve drawings and data sheets provided in Section 4.1 without affecting the shipping date. Delays in delivery due to drawings and data sheets that are disapproved during this review period are the responsibility of the Supplier.
- 4.3. Drawings and data sheets returned to the Supplier as approved shall be considered authorization to proceed with the work. The approval of MEC shall in no way abrogate the requirements of this specification.

5. CERTIFIED LABORATORY TEST REPORTS

Certified tests shall be conducted in accordance with applicable standards. The Supplier shall furnish two (2) copies of certified test reports for all tests to the MEC Procurement Manager within two (2) weeks of delivery along with a statement certifying that the cable meets all the requirements of the applicable standards and this specification.

6. DESIGN AND CONSTRUCTION

6.1. CONDUCTOR

- 6.1.1. The cable shall be supplied in accordance with the data shown in the attached Table A. 15kV Primary UD Cable Jacketed.
- 6.1.2. Insulated conductors shall be soft annealed compressed copper.
- 6.1.3. The stranding shall be concentric.

6.1.4. (Not Used)

6.1.5. Conductor size shall be in accordance with Table A and shall be as specified on the Purchase Order. Standard size for MEC is 2/0-19 Copper conductor- 100% Insulation Concentrically stranded 15kV Primary UD Cable Jacketed.

6.2. INSULATION

6.2.1. The conductor shall be covered by an extruded black semi-conducting cross linked polyethylene strand shield

6.2.2. The strand shield shall be covered by a tree-retardent cross-linked polyethylene primary insulation

6.2.3. The tree-retardent cross-linked polyethylene primary insulation shall be covered by a semi-conducting cross-linked polyethylene insulation shield.

6.2.4. The conductor shall have 100% insulation levels.

6.2.5. A concentric neutral of bare copper wires and an insulating polyethylene jacket is applied over the insulation shield

6.3. IDENTIFICATION OF CABLE

Industry standard marking required. Acceptable method is surface printing on the jacket with a lightning bolt symbol for supply cables indented in the jacket

6.4. REELS

6.4.1. The inner drum end of the cable, when allowed to project through the flange of the reel shall be protected to avoid injury to the cable or cable seal.

6.4.2. Wooden reels shall have steel collars with an outer flange of at least one half inch to withstand handling. Reels with at least 72-inch flanges shall be four-ply and at least three-ply above 60 inches. The mandrel hole

shall have at least two inches of uncut wood all around the hole.

- 6.4.3. Reels shall be designed to support the weight of the cable and withstand handling in accordance with industry practices.
- 6.4.4. The mandrel hole size shall be three inches, minimum.
- 6.4.5. A durable, non-fading label shall be securely attached to a flange of the reel. The label shall plainly indicate the following:
 - A. MEC Purchase Order number
 - B. Shipping length in feet of the cable on the reel
 - C. Beginning and ending sequential footage number
 - D. Number, type, thickness and size of conductor
 - E. Thickness and type of insulation
 - F. Voltage rating
 - G. Tare weight
- 6.4.6. Each reel shall be marked with an arrow and suitable stenciled wording, on the flange of the reel, indicating the direction the reel should be rolled.

7. QUALITY CONTROL

The Supplier shall have a quality control program to ensure compliance with the requirements of this specification. The program shall be documented and available for MEC's review if requested.

Documentation of the quality control program shall indicate where in the production and manufacturing process the quality checks are taken, describe the purpose of the checks, and describe the nature of the check, i.e. if check is visual only or if electrical or mechanical testing is used.

8. PACKING AND SHIPPING

- 8.1. Each end of each length of cable shall be durably sealed before shipment to prevent entrance of moisture. Evidence of water in the cable as received shall be cause for rejection.
- 8.2. The cable shall be placed on the reels in such a manner that it will be protected from injury during shipment. Care shall be taken to prevent the reeled cable from becoming loose. Each end of the cable shall be firmly and properly secured to the reel.
- 8.3. The reels shall be lagged or covered with suitable material to provide physical protection for the cables during transit and during ordinary handling operations and storage. MEC Engineering shall approve the materials and system used to accomplish this.
- 8.4. The reels shall be securely blocked in position so that they will not shift during transit.
- 8.5. The Supplier shall have adequate work and inspection instructions for handling, interim storage, preservation, packaging, and shipping to protect the quality of the cable and prevent damage, loss and deterioration.

TABLE A – Underground Conductor.

15kV Primary UD Cable Jacketed

Code Word	Phase Conductor		Neutral		Thickness (mils)				Diameter (mils)			Weight 1000 ft. (lbs.)		Allowable Ampacities+	
	Size (AWG or kcmil)	Stranding	No. of Wires	Size (AWG)	Strand. Shield	Insul. (Min. Avg.)	Insul. Shield	Jkt.	Bare Phase Cond.	Over Insul.	Over Jkt.	Neutral Wires	Comp. Cable	Direct Burial	In Ducts
ALUMINUM CONDUCTOR - 100% INSULATION															
Cezanne	2	7	10	14	20	175	40	50	283	693	1021	133	468	168*	119*
Van Gogh	1/0	19	16	14	20	175	40	50	362	772	1100	212	611	218*	155*
Goya	2/0	19	20	14	20	175	40	50	406	816	1144	265	706	248*	177*
El Greco	3/0	19	25	14	20	175	40	50	456	866	1194	332	822	284*	201*
Corot	4/0	19	20	12	20	175	40	50	512	922	1264	424	996	324*	230*
Degas	250	37	16	10	25	175	40	50	558	978	1382	538	1198	360*	257*
Hals	350	37	18	14	25	175	60	50	661	1081	1429	239	1030	389**	319**
Rousseau	400	37	20	14	25	175	60	50	706	1126	1474	265	1122	417**	343**
Boach	500	37	25	14	25	175	60	50	789	1209	1557	332	1316	468**	384**
Vernet	750	61	24	12	30	175	60	80	968	1398	1840	509	1904	569**	468**
(n/a)	1000	61	20	10	30	175	80	80	1117	1547	2071	673	2479	642**	542**
COPPER CONDUCTOR - 100% INSULATION															
Titian	2	7	16	14	20	175	40	50	283	693	1021	212	683	210*	150*
Monet	1	19	20	14	20	175	40	50	322	732	1060	265	800	240*	171*
Raphael	1/0	19	25	14	20	175	40	50	362	772	1100	332	947	273*	194*
Rubens	2/0	19	20	12	20	175	40	50	406	816	1178	424	1157	313*	224*
Bruegel	3/0	19	25	12	20	175	40	50	456	866	1228	530	1384	358*	255*
Holbein	4/0	19	20	10	20	175	40	50	512	922	1326	673	1710	410*	283*
Moreau	250	37	24	10	25	175	40	50	558	978	1382	807	1979	446*	322*
McNeil	350	37	18	12	25	175	60	50	661	1081	1463	381	1939	489**	400**
Courbet	400	37	20	12	25	175	60	50	706	1126	1508	424	2154	523**	426**
Daumier	500	37	26	12	25	175	60	50	789	1209	1591	551	2620	577**	472**
(n/a)	750	37	15	8	30	175	60	80	1368	1398	1935	802	3893	649**	532**
+Ampacities shown assume use of 100% load factor, 60 Hz current, 36" burial depth, 20°C ambient temperature, 90°C conductor temperature, earth RHO 90, insulation and shield RHO 400. *Full neutral conductor, single phase circuit, one cable. **1/3 neutral cable, three phase circuit, 3 cables triplexed, multi-point grounding per IEEE methods.															

End of Specification.