


NOTE

1. FITTINGS ARE INDICATIVE ONLY - CONTRACTOR SHOULD REVIEW FITTINGS SUPPLIED AGAINST ARRANGEMENT SHOWN TO CONFIRM SUITABILITY PRIOR TO ORDERING.
2. TO BE OF SUFFICIENT LENGTH TO ALLOW CONNECTION TO STRUCTURE TO REMAIN SLACK UNDER ALL OPERATING CONDITIONS. CHECK ELECTRICAL CLEARANCES DURING INSTALLATION.
3. FAULT RATING OF ASSEMBLY TO MATCH OR EXCEED FAULT RATING OF OPGW.
4. ALL BOLTED FITTINGS TO COMPLY WITH AS1154 AND TO BE SUPPLIED WITH SPLIT PIN.
5. ALL NUTS & SPLIT PINS ARE TO BE ORIENTATED IN THE SAME DIRECTION OR TOWARDS GROUND LEVEL WHERE POSSIBLE.

QTY.	ITEM	DESCRIPTION	REFERENCE/REMARKS
1	1	ARMOUR GRIP SUSPENSION UNIT, COMPLETE W/ CURRENT TRANSFER TAB, TO SUIT Ø7.6mm OPGW	REFER AS1154
1	2	EARTH BONDING LEAD, LENGTH TO SUIT	REFER AS1154
1	3	CLEVIS/TONGUE, TWISTED, 16mm, 70kN F/L	REFER AS1154
1	4	LINK PLATE, 135mm C-C, 16mm, 70kN F/L	REFER AS1154
2	5	SHACKLE, 16mm, 70kN F/L	REFER AS1154
2	6	BOLT ASSEMBLY, M12x35, GALVANISED	REFER AS1111

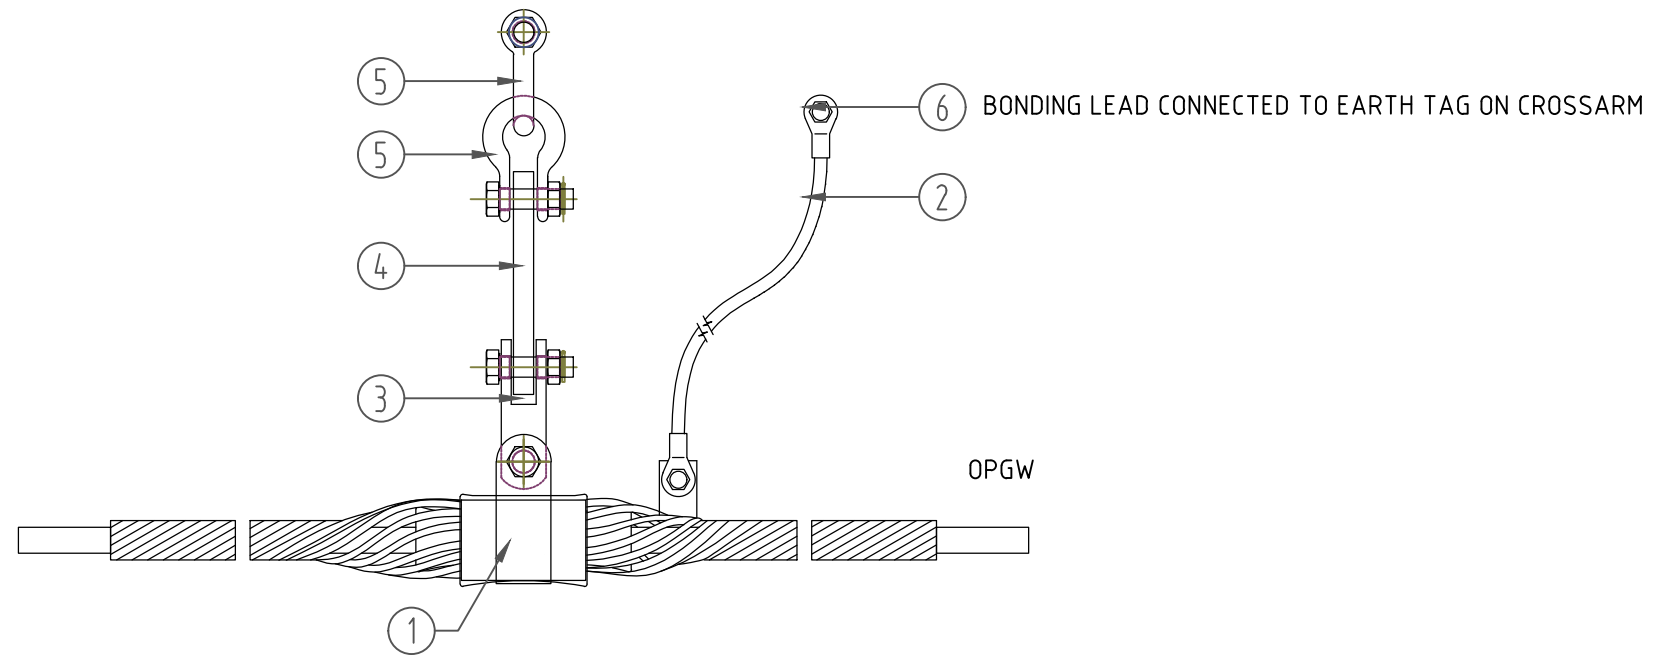

SIDE VIEW

ENTURA IS A BUSINESS OF HYDRO-ELECTRIC CORPORATION ABN 48 072 377 158

DRAWN	AJD
CHECKED	
DESIGNED	
CHECKED	
APPROVED	
DATE	
CLIENT APP'D	
DATE	

entura
 WE OWN. WE OPERATE. WE CONSULT.
 89 Cambridge Park Drive, Cambridge,
 Tasmania, 7170, AUSTRALIA
 Ph: 03 6245 4500 Fax: 03 6245 4550
www.entura.com.au
 © COPYRIGHT 2012

CLIENT	SOLOMON POWER	ENGAGEMENT No:	E307765
TITLE	LUNGA - HONIARA 33kV TRANSMISSION LINE OPGW SUSPENSION (TO SUIT Ø7.6mm OPGW) ASSEMBLY		
DRG No.	SP-LH-AS-003	SHT.	001
		REV.	0 A3