



LEGEND:

AREA TO BE
LEASED 28,000 SF



RETAINING
WALL



SLUDGE POND

TURBIDITY PLANT

AREA TO BE LEASED

BOUNDARY OF AREA
TO BE SURVEYED

KOLOPA'S HOUSE

WELL 81

WELL 72

1
C1

LOCATION PLAN

SCALE: 1:100

2
C1

VICINITY MAP

SCALE: NTS

REV. NO.:

REVISION:

CHECKED BY:

APPROVED BY:

DATE:

PREPARED BY:

WATER ENGINEERING

CHECKED BY:

WATER ENGINEERING

APPROVED BY:

W. SWORD, P.E.

ISSUE FOR:

CONSTRUCTION



AMERICAN SAMOA POWER AUTHORITY

ENGINEERING SERVICES DIVISION
TAFUNA, AMERICAN SAMOA

P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675

PROJECT NAME:

TURBIDITY PLANT PROJECT

DRAWING TITLE:

VICINITY MAP, LOCATION PLAN

PROJECT LOCATION:

NUU'ULI VILLAGE, AMERICAN SAMOA

SCALE:

1:100

DATE:

OCT2025

PROJECT NO.:

SHEET NO.


C1

SIGNATURE:

DATE:

LEGEND:


LEASE AREA
28,000 SF



RETAINING
WALL



1 SITE DEVELOPMENT PLAN
C2 SCALE: 1:30

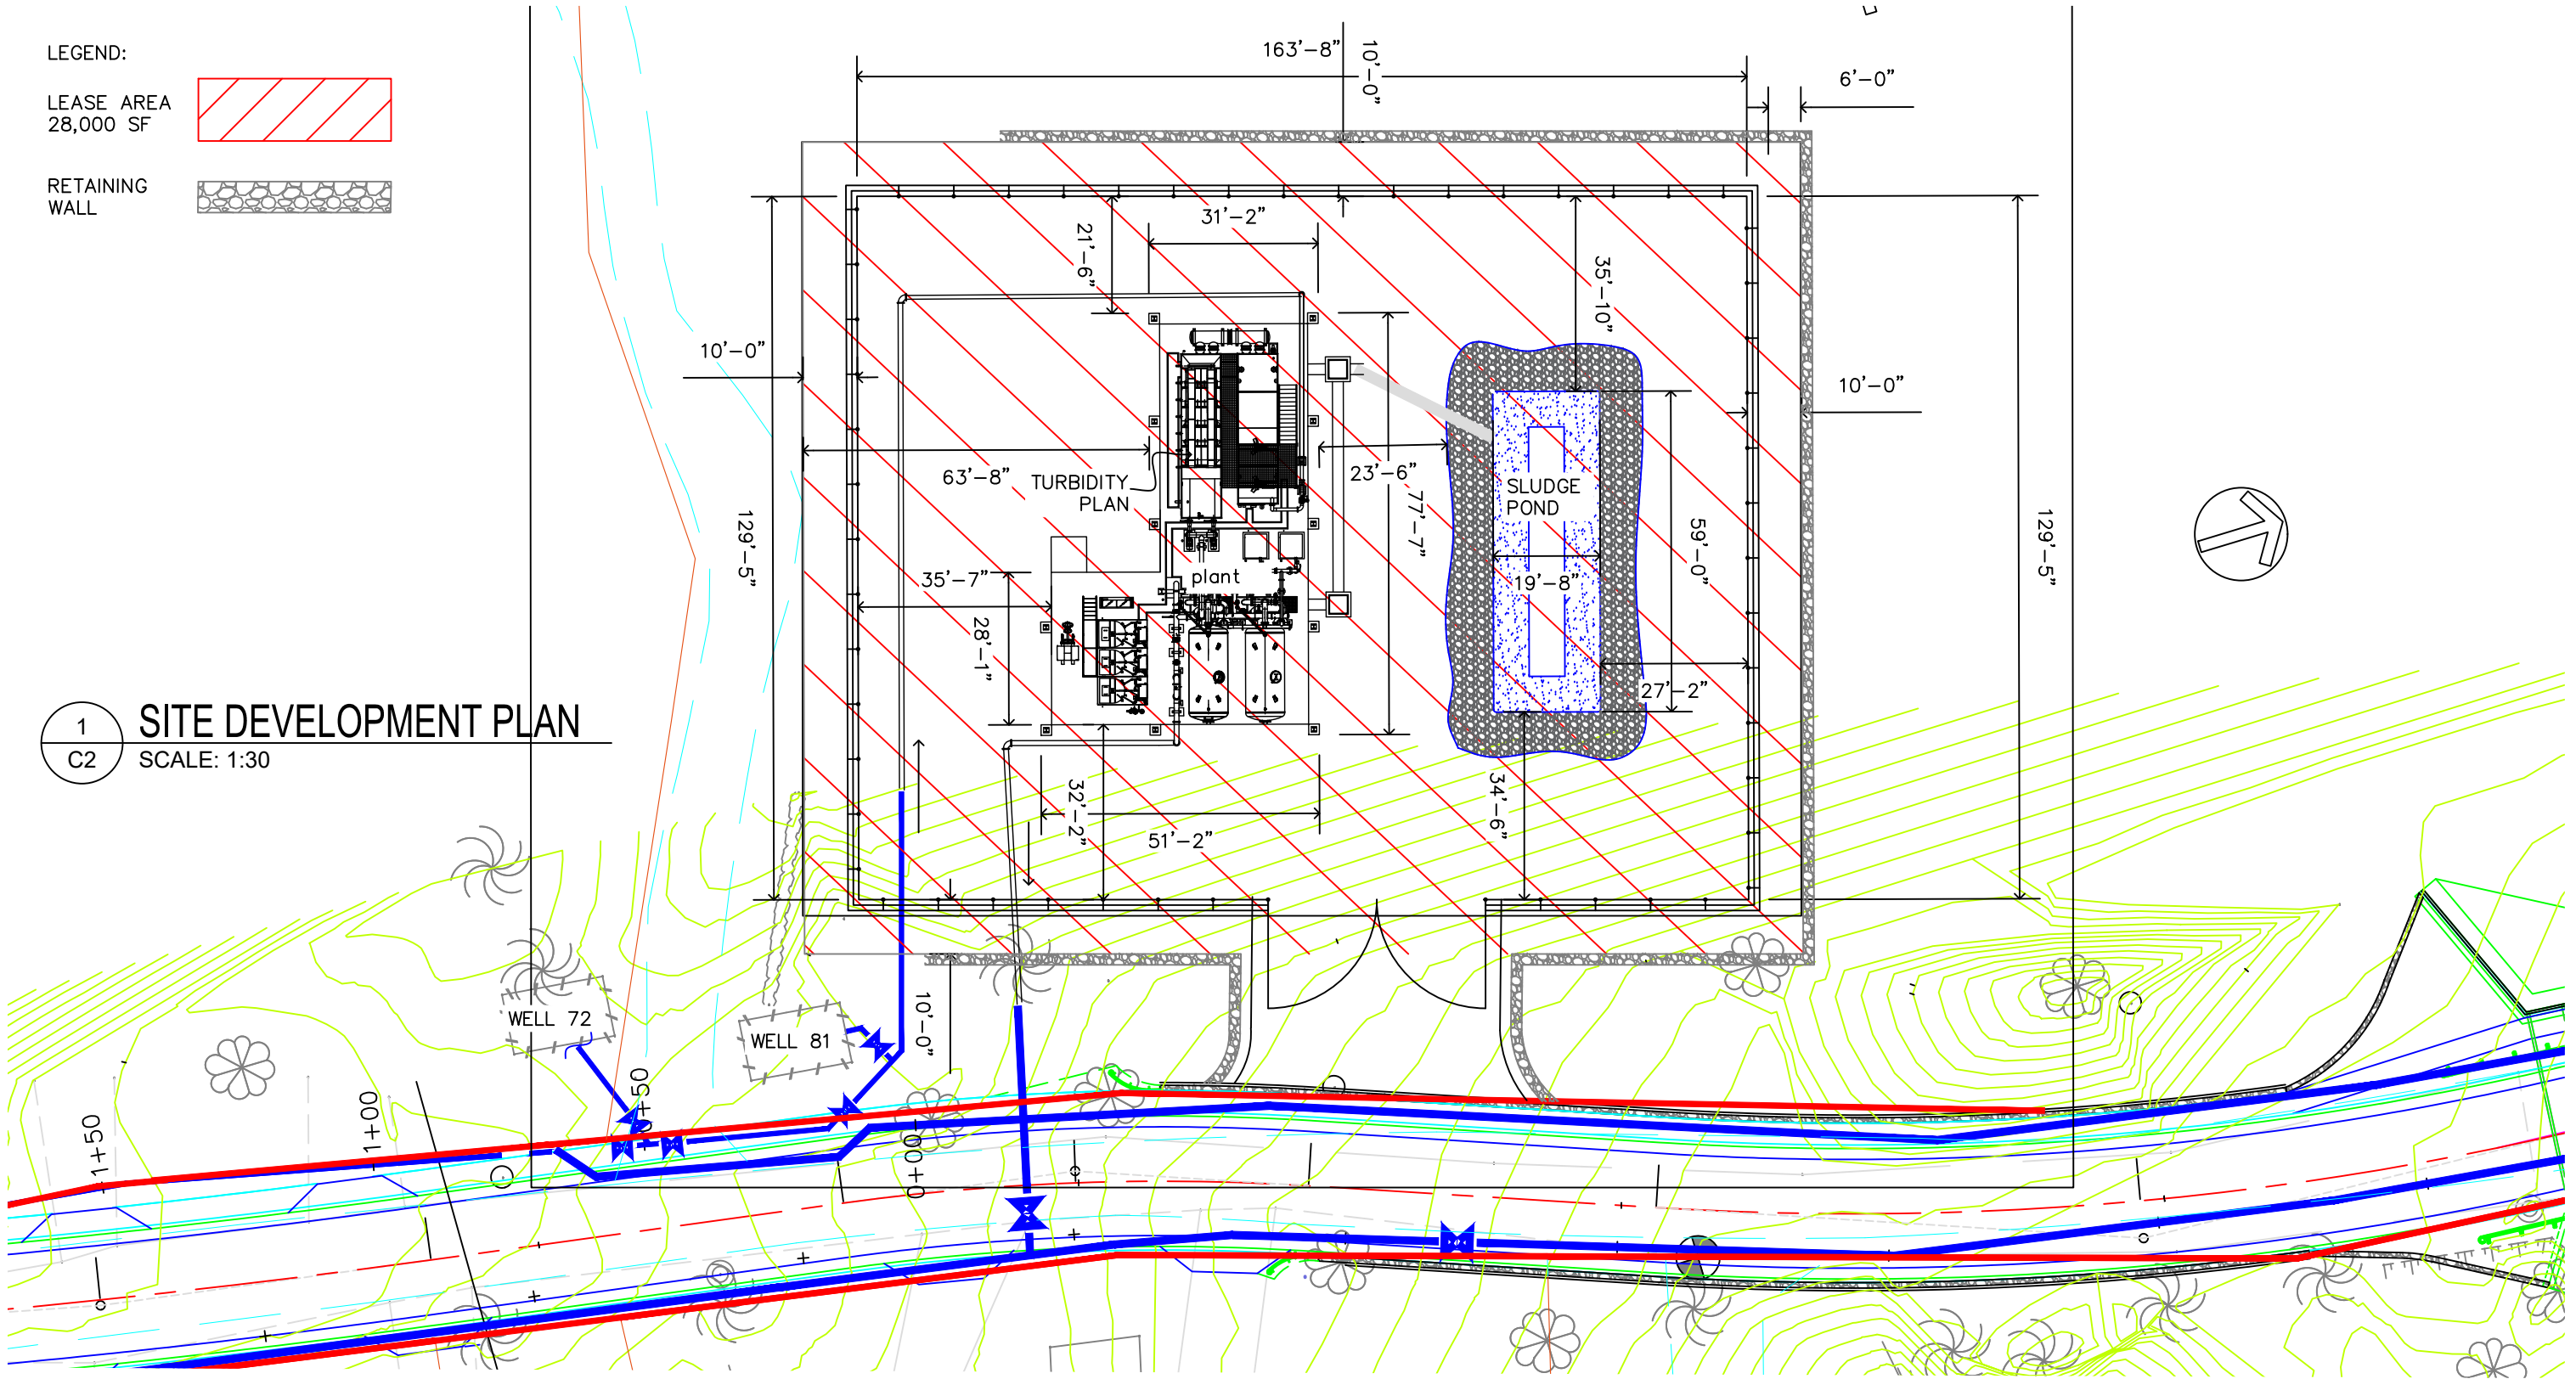

REV. NO.:

REVISION:

CHECKED BY:

APPROVED BY:

DATE:

PREPARED BY:

WATER ENGINEERING

CHECKED BY:

WATER ENGINEERING

APPROVED BY:

W. SWORD, P.E.

ISSUE FOR:

CONSTRUCTION



AMERICAN SAMOA POWER AUTHORITY

ENGINEERING SERVICES DIVISION
TAFUNA, AMERICAN SAMOA

P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675

PROJECT NAME:

TURBIDITY PLANT PROJECT

DRAWING TITLE:

SITE DEVELOPMENT PLAN

PROJECT LOCATION:

NUU'ULI VILLAGE, AMERICAN SAMOA

SCALE:

1: 30

PROJECT NO:

DATE:




OCT2025

SHEET NO.


C2

SIGNATURE:


DATE:

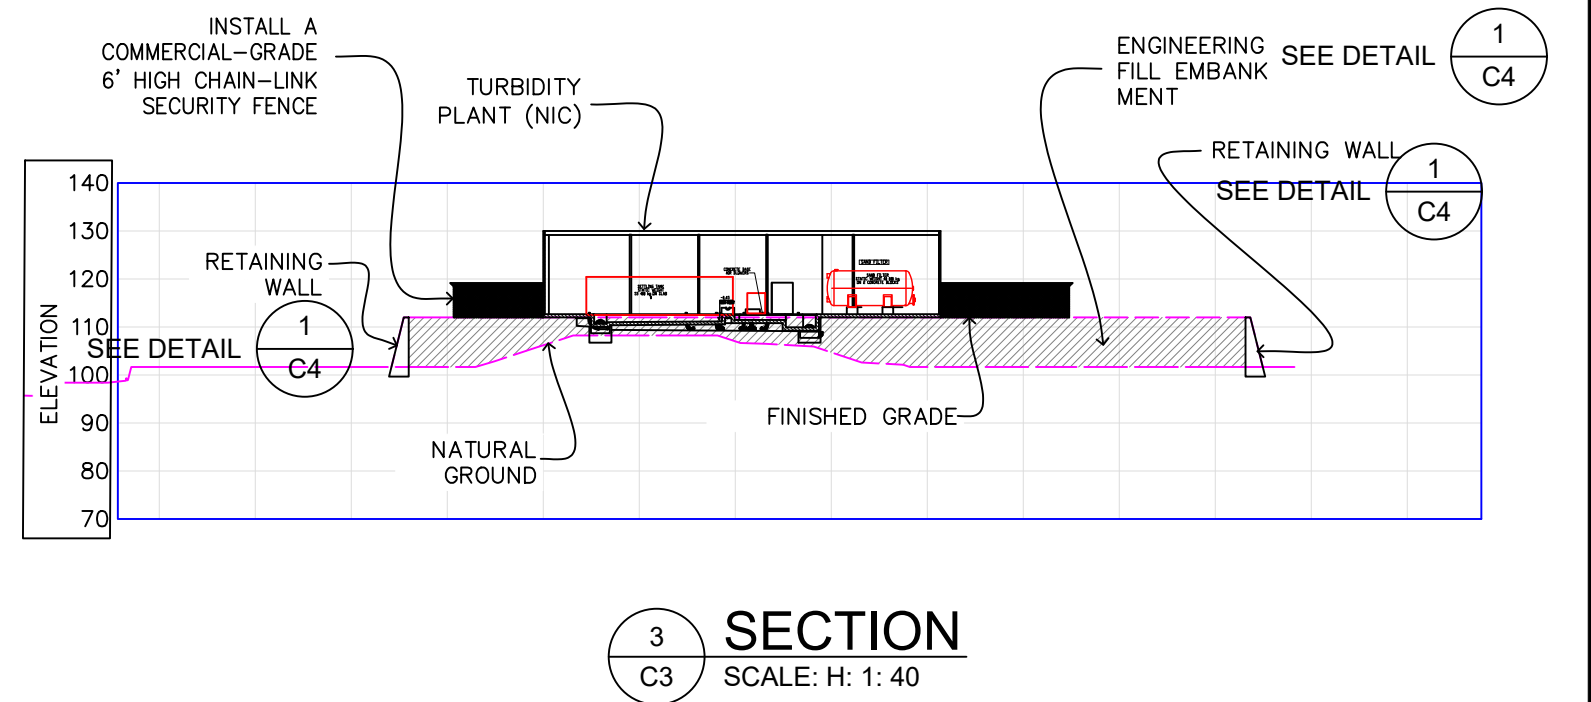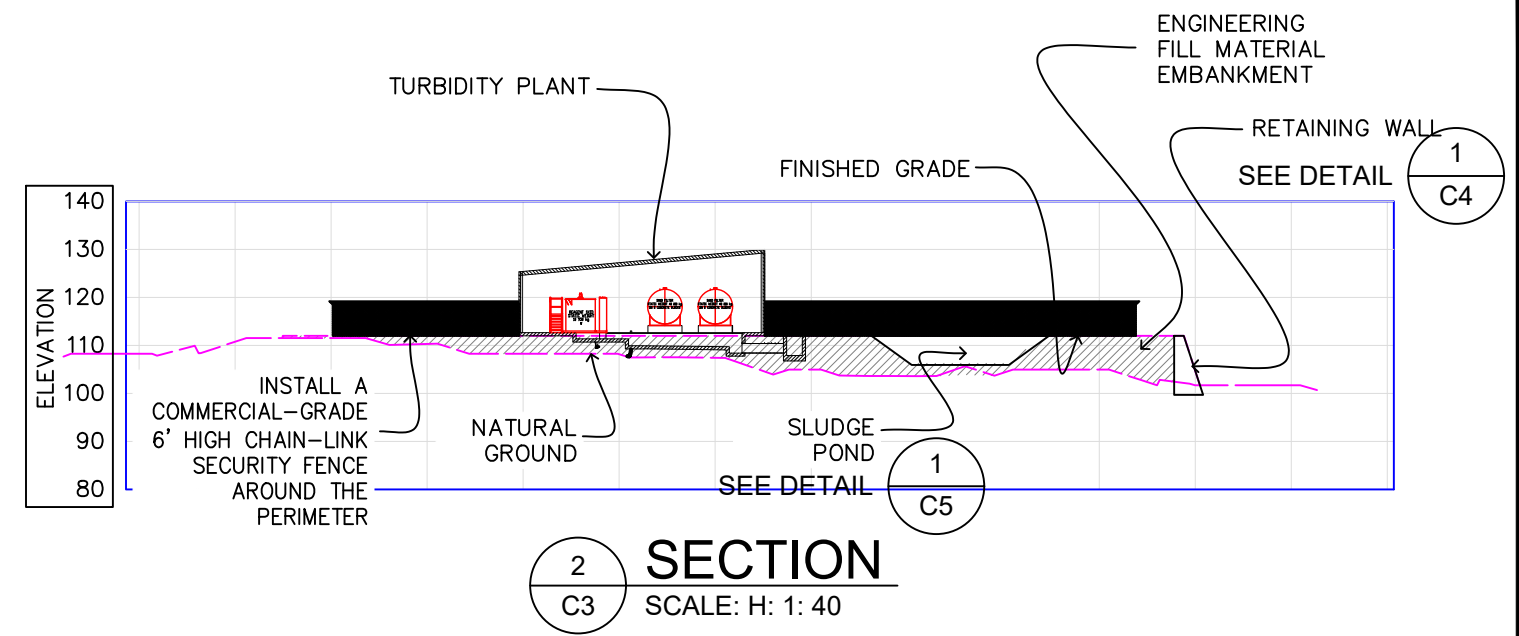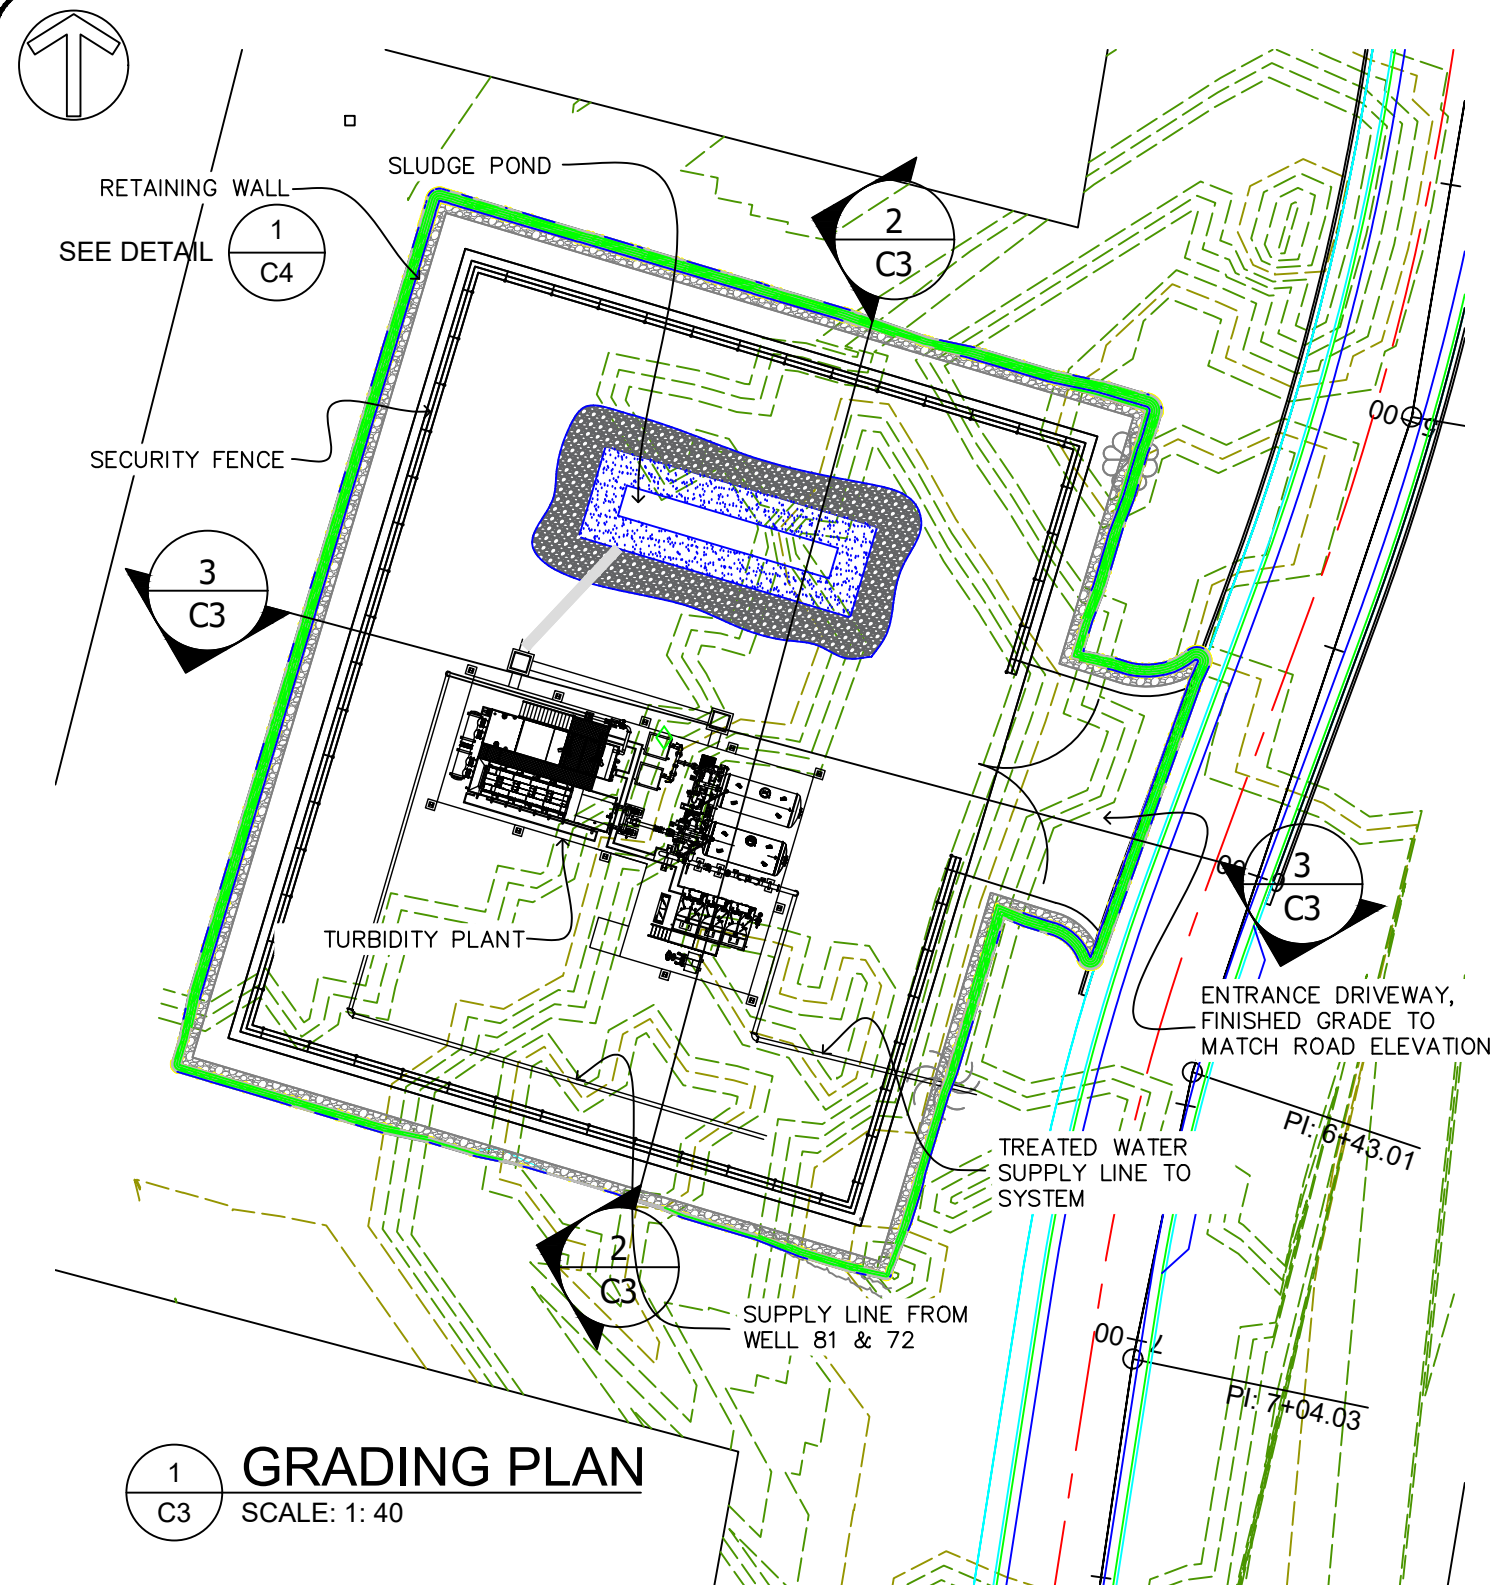

REV. NO.:	PREPARED BY: WATER ENGINEERING	 ENGINEERING SERVICES DIVISION TAFUNA, AMERICAN SAMOA P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675 AMERICAN SAMOA POWER AUTHORITY	PROJECT NAME: TURBIDITY PLANT PROJECT	SCALE: AS SHOWN	PROJECT NO.:	
REVISION:	CHECKED BY: WATER ENGINEERING		DRAWING TITLE: SITE GRADING& SECTIONS			
CHECKED BY:	APPROVED BY: W. SWORD, P.E.		PROJECT LOCATION: NUU'ULI VILLAGE, AMERICAN SAMOA	DATE: OCT2025	SHEET NO. C3	SIGNATURE:
APPROVED BY:	ISSUE FOR: CONSTRUCTION					DATE:
DATE:						

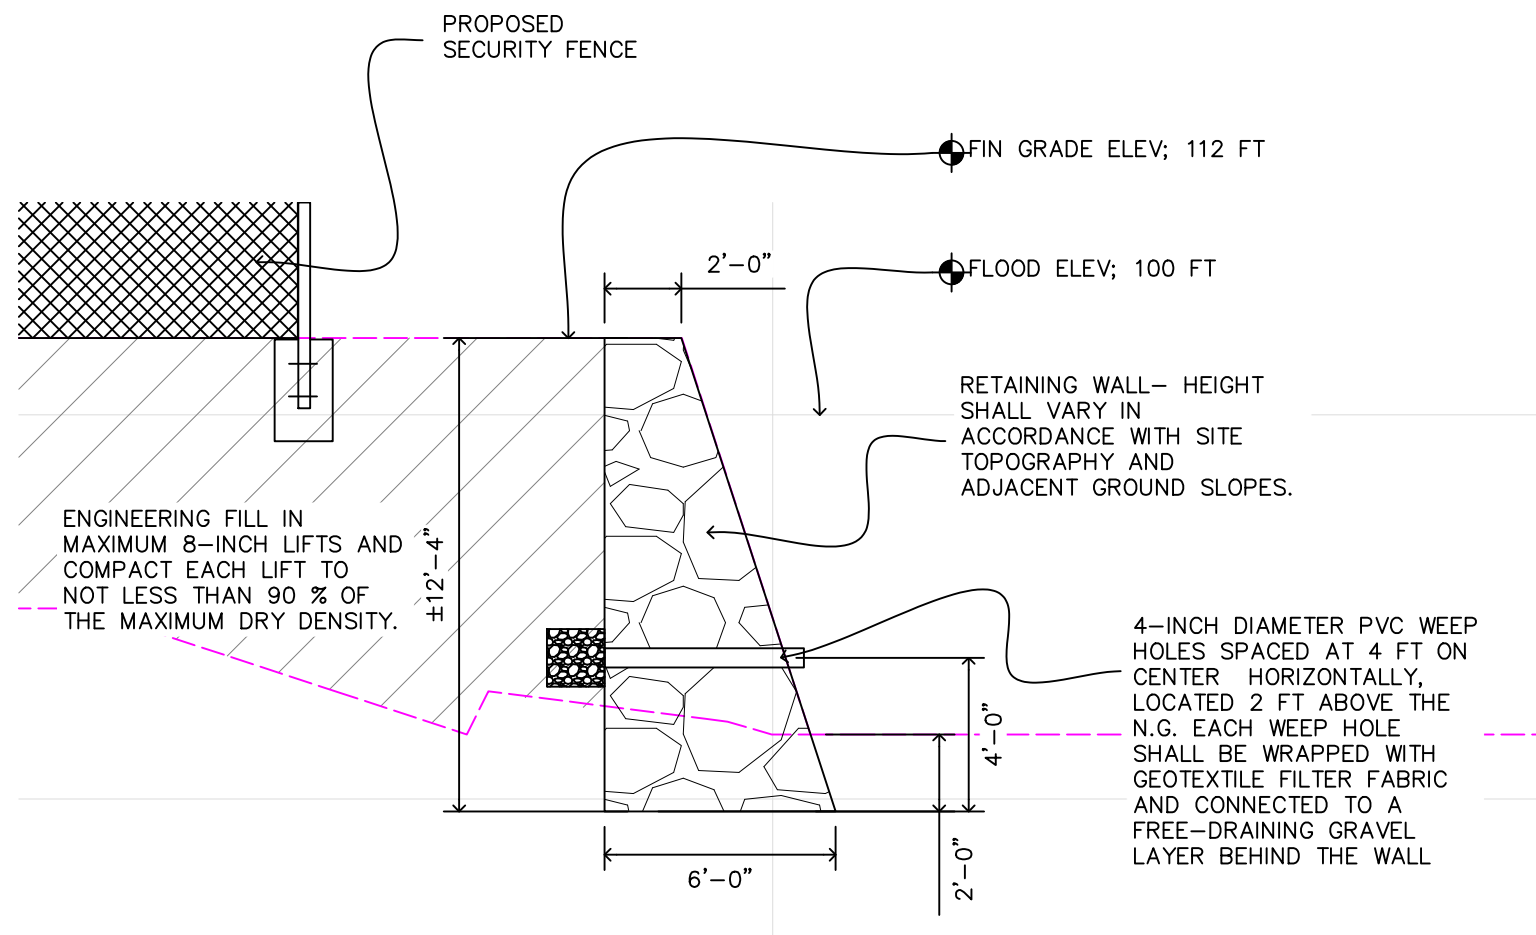


1 TYP. RETAINING WALL SECTION (ROCK WALL OPTION)
C4 SCALE: NTS

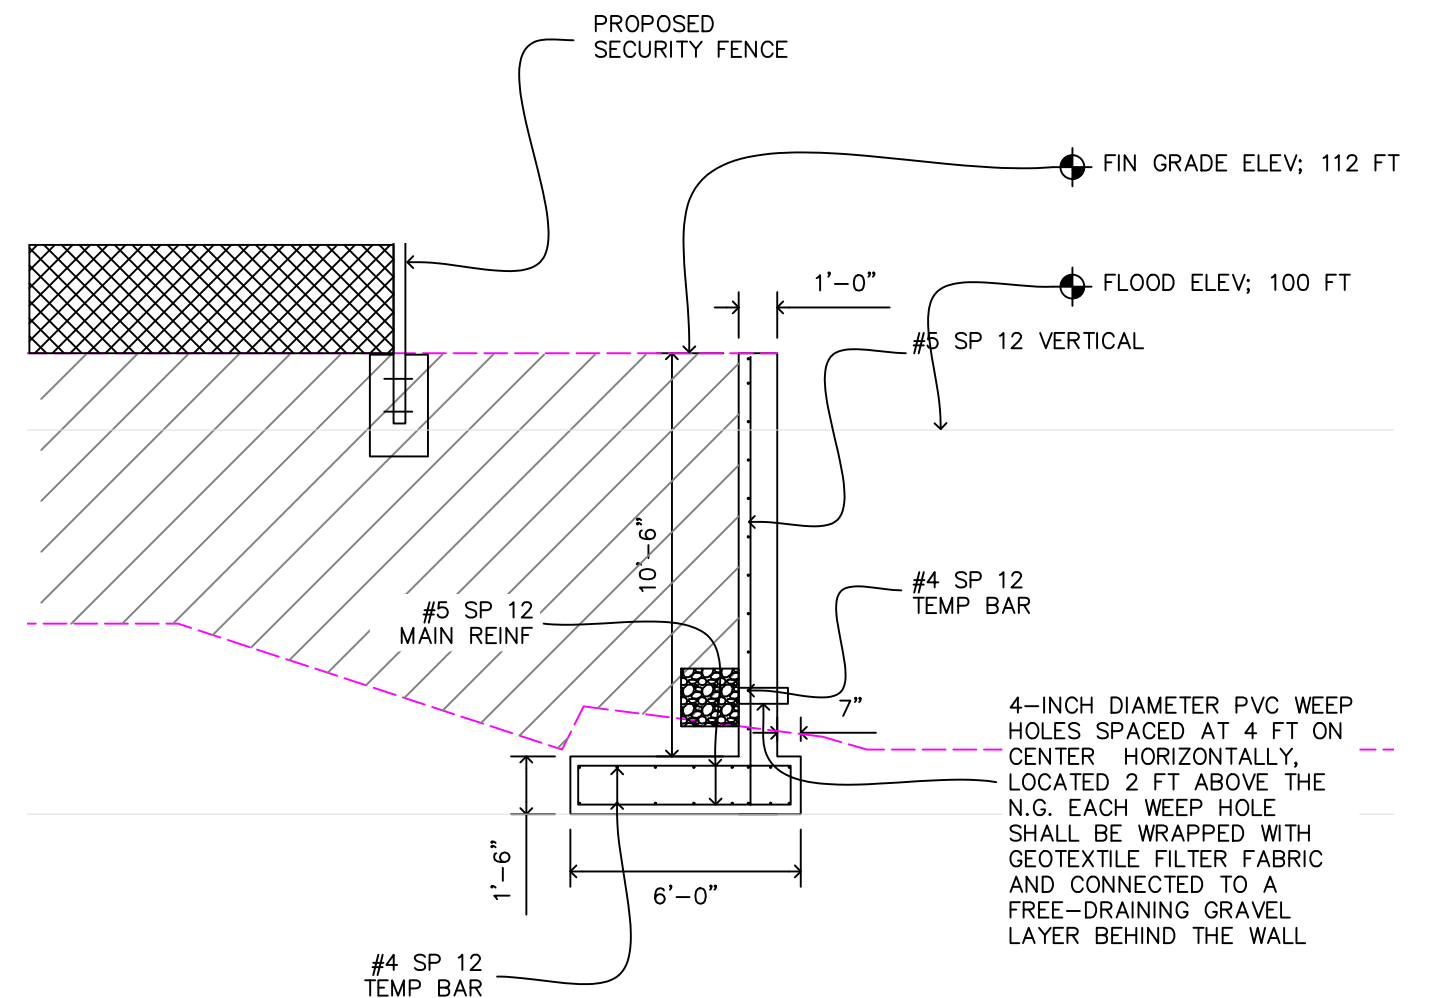

2 TYP. RETAINING WALL SECTION (R.C. OPTION)
C4 SCALE: NTS

REV. NO.:	PREPARED BY: WATER ENGINEERING	 ENGINEERING SERVICES DIVISION TAFUNA, AMERICAN SAMOA P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675 AMERICAN SAMOA POWER AUTHORITY	PROJECT NAME: TURBIDITY PLANT PROJECT	SCALE: AS SHOWN	PROJECT NO.:	
REVISION:	CHECKED BY: WATER ENGINEERING		DRAWING TITLE: RETAINING WALL SECTION			
CHECKED BY:	APPROVED BY: W. SWORD, P.E.		PROJECT LOCATION: NUU'ULI VILLAGE, AMERICAN SAMOA	DATE: OCT2025	SHEET NO. C4	SIGNATURE:
APPROVED BY:	ISSUE FOR: CONSTRUCTION					DATE:
DATE:						

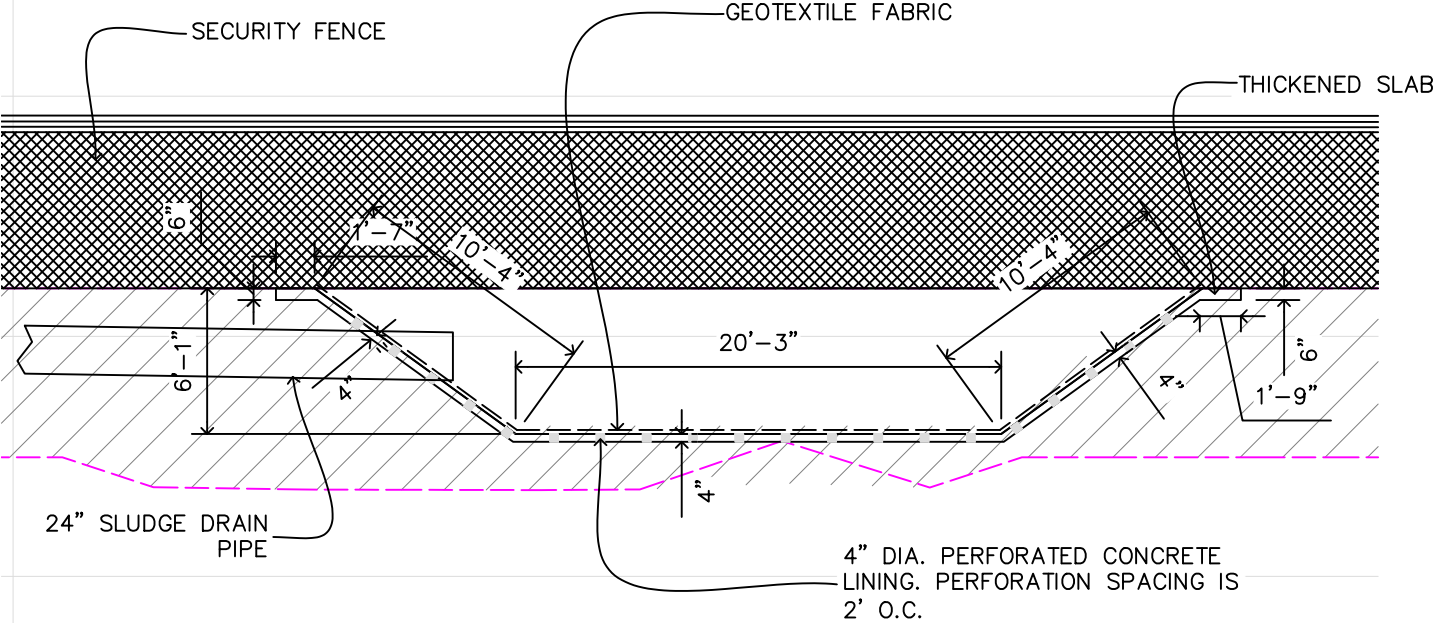


1
C5

SLUDGE POND SECTION

SCALE: 1: 8

REV. NO.:	PREPARED BY: WATER ENGINEERING	 ENGINEERING SERVICES DIVISION TAFUNA, AMERICAN SAMOA P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675 AMERICAN SAMOA POWER AUTHORITY	PROJECT NAME: TURBIDITY PLANT PROJECT		SCALE: AS SHOWN	PROJECT NO.:	
REVISION:	CHECKED BY: WATER ENGINEERING		DRAWING TITLE: SLUDGE POND DETAIL				
CHECKED BY:	APPROVED BY:		PROJECT LOCATION: NUU'ULI VILLAGE, AMERICAN SAMOA		DATE: OCT2025	SHEET NO. C5	SIGNATURE:
APPROVED BY:	ISSUE FOR: CONSTRUCTION						DATE:
DATE:							

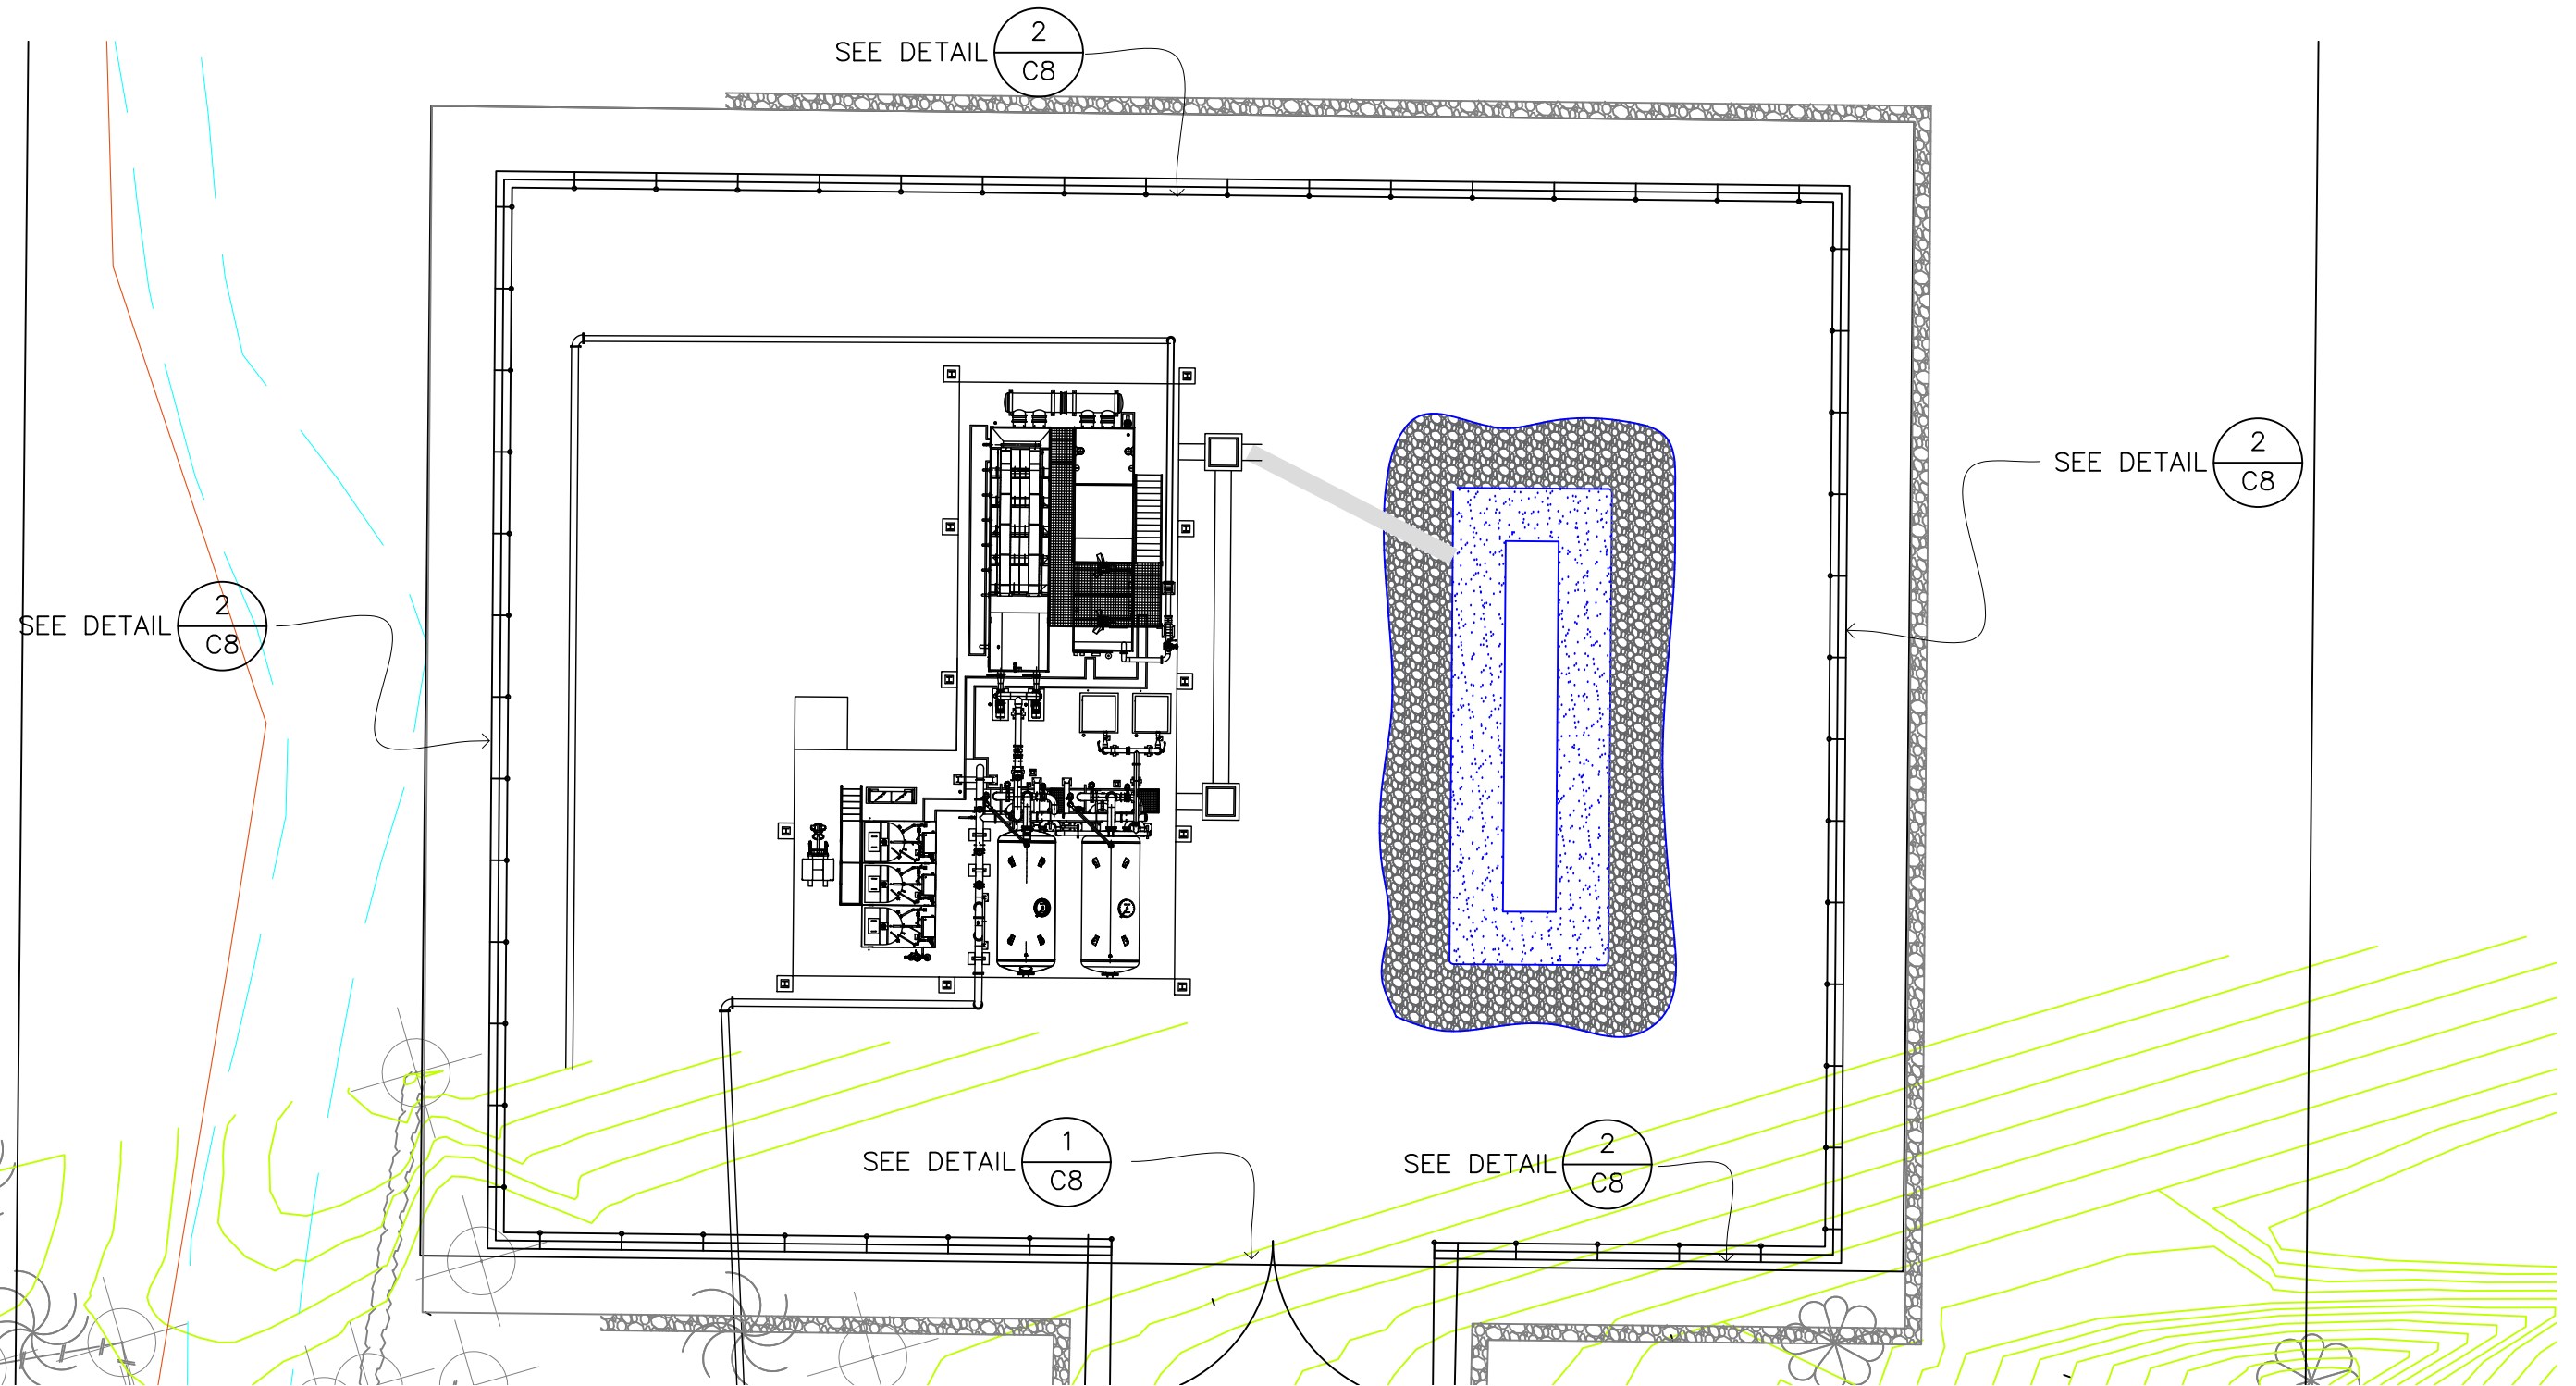

1 FENCE PLAN LAYOUT
C5 SCALE: 1: 22

REV. NO.:	PREPARED BY: WATER ENGINEERING	 ENGINEERING SERVICES DIVISION TAFUNA, AMERICAN SAMOA P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675 AMERICAN SAMOA POWER AUTHORITY	PROJECT NAME:	TURBIDITY PLANT PROJECT		SCALE:	AS SHOWN		PROJECT NO.:
REVISION:	CHECKED BY: WATER ENGINEERING		DRAWING TITLE:	FENCE PLAN					
CHECKED BY:	APPROVED BY:		PROJECT LOCATION:	NUU'ULI VILLAGE, AMERICAN SAMOA		DATE:	OCT2025	SHEET NO.	SIGNATURE:
APPROVED BY:	W. SWORD, P.E.							C6	DATE:
DATE:	ISSUE FOR: CONSTRUCTION								

SPECIFICATIONS

1. CHAIN LINK FENCING:

(A) GENERAL.

UNLESS STATED OTHERWISE, ALL MATERIALS FOR CHAIN LINK FENCING AND GATES, ABOVE AND BELOW GROUND, SHALL BE PVC COATED AS SPECIFIED IN THE CURRENT ASTM F 668.

(B) POSTS

ALL POSTS SHALL BE OF SUFFICIENT LENGTH TO PROVIDE A 36-INCH MINIMUM SETTING IN CONCRETE FOOTINGS, AT A DEPTH AND SPACING SPECIFIED ON THE PLANS. POSTS SHALL BE SET AT A MINIMUM SPACING OF 10’ O.C. POSTS SHALL BE IN PROPER ALIGNMENT SO THAT THERE IS A MINIMUM OF 4” ON ALL SIDES OF THE POST. NO MATERIAL SHALL BE INSTALLED ON THE POST NOR SHALL THE POST BE DISTURBED IN ANY MANNER WITHIN 7 DAYS AFTER THE INDIVIDUAL POST FOOTING IS COMPLETED. SHOULD ROCK BE ENCOUNTERED AT A DEPTH LESS THAN THE PLANNED FOOTING DEPTH A HOLE 2” LARGER THAN GREATEST DIMENSION OF THE POST SHALL BE DRILLED TO A DEPTH OF 12”. NO EXTRA COMPENSATION SHALL BE MADE FOR ROCK EXCAVATION.

(1) ALL POSTS SHALL BE PVC COATED STEEL, 35 PERCENT MINIMUM CARBON CONTENT, 60,000 POUNDS PER SQUARE INCH MINIMUM TENSILE STRENGTH (SCHEDULE 40).

(2) LINE POSTS SHALL BE 2-3/8 INCH O.D. PIPE WEIGHING 3.65 POUNDS PER LINEAR FOOT OR 2 INCH X 2-1/4 INCH H SECTION WEIGHING 4.10 POUNDS PER LINEAR FOOT UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(3) END, CORNER AND PULL POSTS SHALL BE 2-7/8 INCH O.D. PIPE WEIGHING 5.79 POUNDS PER LINEAR FOOT UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(4) GATE POSTS. FOR SINGLE GATE OR ONE LEAF OF DOUBLE GATES:

(AA) UP TO 6 FEET WIDE. 3 INCH O.D. PIPE WEIGHT 5.79 POUNDS PER LINEAR FOOT UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(AB) 6 FEET TO 15 FEET WIDE. 4 O.D. PIPE WEIGHING 9.11 POUND PER LINEAR FOOT.

(5) POST TOPS. TUBULAR POST TOPS DESIGNED TO PREVENT MOISTURE FROM ENTERING POSTS AND TO SUPPORT TOP RAIL.

(C) TOP RAILS.

(1) 1-1/2 INCH I.D. PVC COATED STEEL PIPE WEIGHING 2.27 POUNDS PER LINEAR FOOT.

(2) PROVIDED WITH PVC COATED, OUTSIDE SLEEVE, SELF-CENTERING 7-INCH LONG COUPLINGS APPROXIMATELY EVERY 20 FEET.

(D) HORIZONTAL BRACES.

(1) BRACES SHALL BE 1-1/2 INCH I.D. PVC COATED STEEL PIPE WEIGHING 2.27 POUNDS PER LINEAR FOOT WITH PLAIN ENDS.

(E) DIAGONAL BRACES.

(1) DIAGONAL BRACES SHALL BE 3/8 O.D. INCH DIAMETER GALVANIZED STEEL RODS OR AS SPECIFIED ON DRAWING.

(2) DIAGONAL BRACES SHALL BE PROVIDED WITH HEAVY GALVANIZED IRON TURNBUCKLES TO ADJUST THE TENSION.

(F) FENCE FABRIC.

(1) WIRE. 9 GAUGE GALVANIZED STEEL WIRE, OF MEDIUM HIGH CARBON QUALITY, MINIMUM TENSILE STRENGTH OF 70,000 POUNDS PER SQUARE INCH, INTERWOVEN INTO 2 INCH DIAMOND MESH.

(2) FABRIC. 72 INCHES WIDE, SELVAGE SHALL BE KNUCKLED AT BOTTOM AND TWISTED AND BARBED AT TOP.

(G) BARBED WIRE

GALVANIZED BARBED WIRE SHALL BE 10 GAUGE WITH 10 GAUGE BARBS. ALL BARBS SHALL BE 4 POINTS AND SPACING OF BARBS SHALL BE 4 TO 6 INCHES.

(H) FABRIC CONNECTIONS AND INSTALLATION.

(1) TERMINAL POST SHALL BE FASTENED BY 3/16 INCH X 3/4 INCH STAINLESS STEEL STRECHER BARS WITH 11 GAUGE STAINLESS STEEL OR ALUMINUM BANDS UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(2) ALL LINE POSTS SHALL BE FASTENED WITH 9 STAINLESS STEEL OR ALUMINUM WIRE CLIPS WIRE CLIPS UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(3) ALL TOP RAILS SHALL BE FASTENED WITH 9 GAGE STAINLESS STEEL OR ALUMINUM TIE WIRES


(4) THE BOTTOM EDGE OF THE FABRIC SHALL BE FASTENED BY 1/8 INCH PVC GALVANIZED TENSION BARS WITH 11 GAGE STAINLESS STEEL OR ALUMINUM BANDS UNLESS OTHERWISE SPECIFIED ON DRAWINGS.

(5) THE FENCE SHALL GENERALLY FOLLOW THE CONTOUR OF THE GROUND, WITH THE BOTTOM OF THE FENCE NO MORE THAN 2” FROM GROUND SURFACE. AT LOCATIONS OF SMALL NATURAL SWALES AND WHERE IT IS NOT PRACTICAL TO HAVE THE FENCE CONFORM TO THE GENERAL CONTOUR OF GROUND SURFACE, LONGER POST MAY BE USED AND MULTIPLE STRANDS OF BARBED WIRE STRETCHED THEREON TO SPAN THE OPENING BELOW FENCE. VERTICAL CLEARANCE BETWEEN STRANDS OF BARBED WIRE SHALL BE 4” OR LESS.

(I) CONCRETE.

CONCRETE SHALL BE OF A COMMERCIAL GRADE WITH A MIN 28-DAY COMPRESSION STRENGTH OF 2500PSI. ALL CONCRETE SHALL BE PLACED AGAINST SOLID, UNDISTURBED OR RE-COMPACTED 95% FILL MATERIALS. ALL AGGREGATES SHALL COMPLY WITH LATEST ACI REQUIREMENTS. CEMENT SHALL BE TYPE II PORTLAND. CONCRETE MIX DESIGN (PROPORTION) SHALL BE SUBMITTED TO ASPA FOR APPROVAL PRIOR TO ANY CONCRETE PLACEMENT.


REV. NO.:	PREPARED BY: WATER ENGINEERING	 ENGINEERING SERVICES DIVISION TAFUNA, AMERICAN SAMOA P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675 AMERICAN SAMOA POWER AUTHORITY	PROJECT NAME:	SCALE:	PROJECT NO:	
REVISION:	CHECKED BY: WATER ENGINEERING		TURBIDITY PLANT PROJECT	—		
CHECKED BY:	APPROVED BY:		DRAWING TITLE:			
APPROVED BY:	W. SWORD, P.E.		FENCE SPECIFICATIONS			
DATE:	ISSUE FOR: CONSTRUCTION		PROJECT LOCATION:	DATE:	SHEET NO.	SIGNATURE:
		NUU’ULI VILLAGE, AMERICAN SAMOA	OCT2025	C7	DATE:	

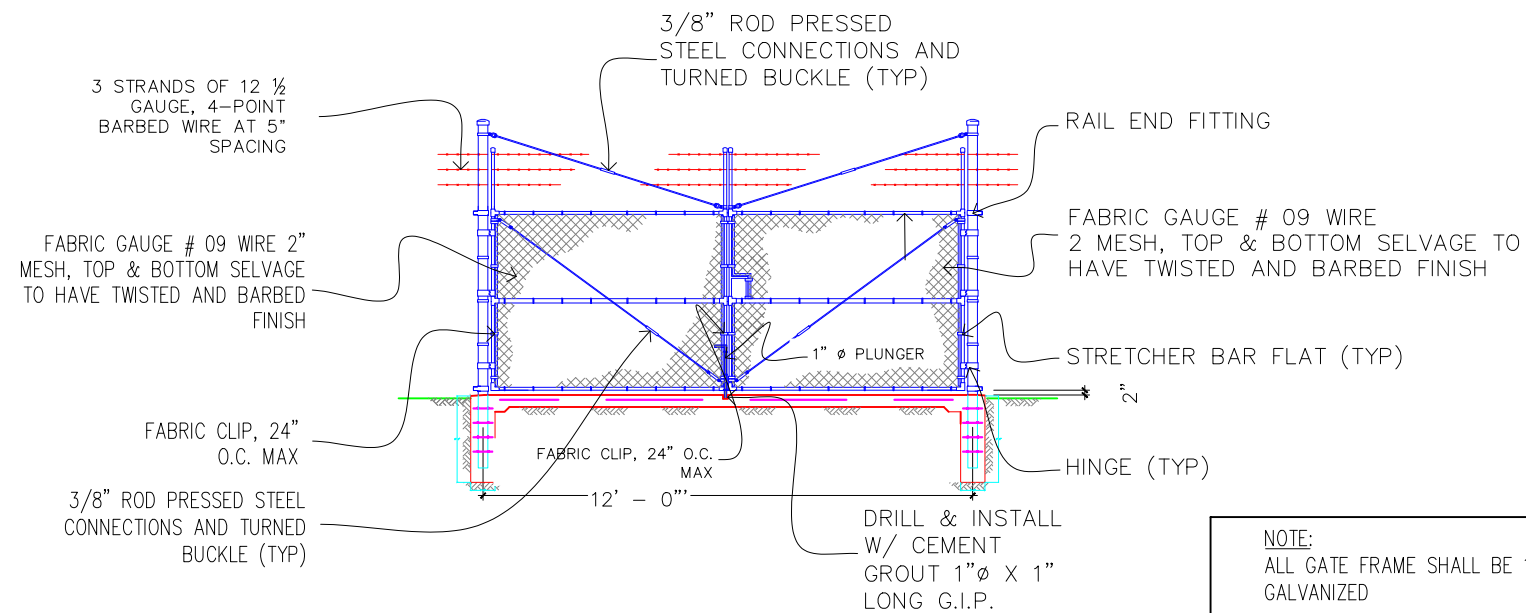

1 GATE FRONT VIEW
C7 SCALE: 1: 5


NOTE:
ALL GATE FRAME SHALL BE 1-7/8"OD GALVANIZED

GATE & CORNER POST SHALL BE 3" OD GALVANIZED

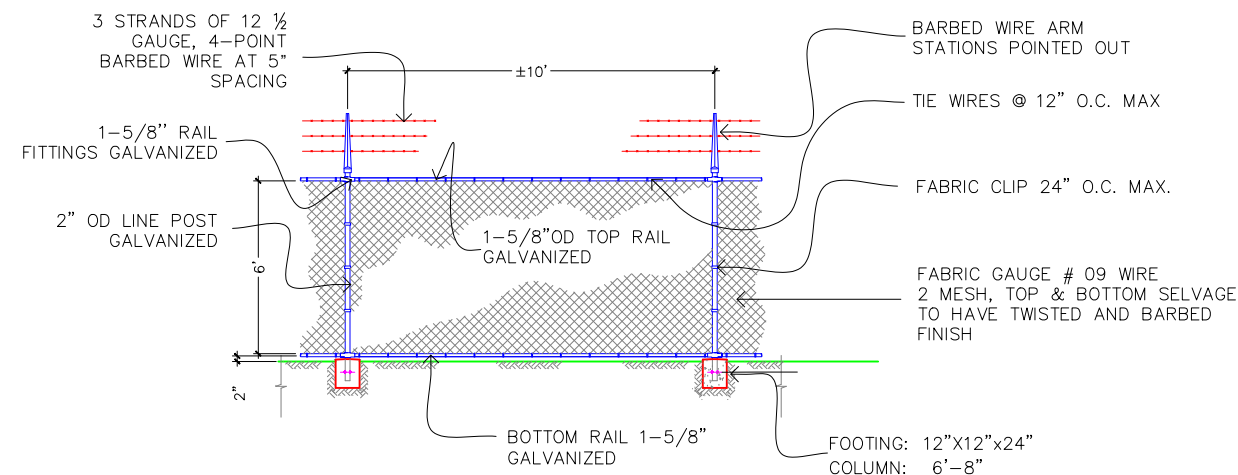


2 LINE FENCE VIEW
C7 SCALE: 1: 5

NOTE:
SPAN @ 10 FT. MAXIMUM
HEIGHT OF CHAIN LINK = 6 FT.
PROVIDE DIAGONAL BRACE @ CORNERS = 1-3/8" OD
FOR SPAN & GATE, REFER TO STANDARDS

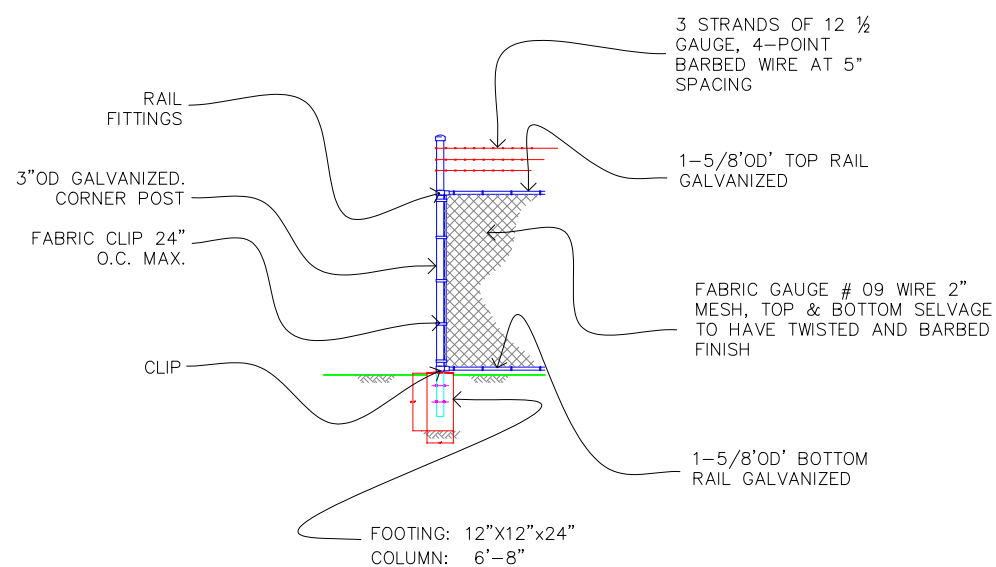

3 FENCE DETAIL
C7 SCALE: NTS

NOTE: ALL CONCRETE SHALL BE 3000 PSI

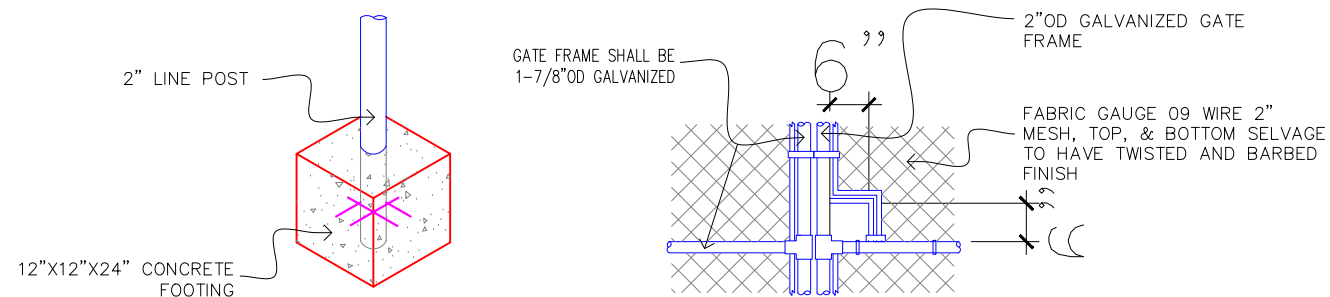

4 FENCE DETAIL
C7 SCALE: NTS

REV. NO.:

REVISION:

CHECKED BY:

APPROVED BY:

DATE:

PREPARED BY:
WATER ENGINEERING

CHECKED BY:
WATER ENGINEERING

APPROVED BY:
W. SWORD, P.E.

ISSUE FOR:
CONSTRUCTION



AMERICAN SAMOA POWER AUTHORITY

ENGINEERING SERVICES DIVISION
TAFUNA, AMERICAN SAMOA
P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675

PROJECT NAME:

TURBIDITY PLANT PROJECT

DRAWING TITLE:

FENCE DETAILS

PROJECT LOCATION:

NUU'ULI VILLAGE, AMERICAN SAMOA

SCALE:

NTS

DATE:

OCT2025


PROJECT NO.:

SHEET NO.


C8

SIGNATURE:


DATE:

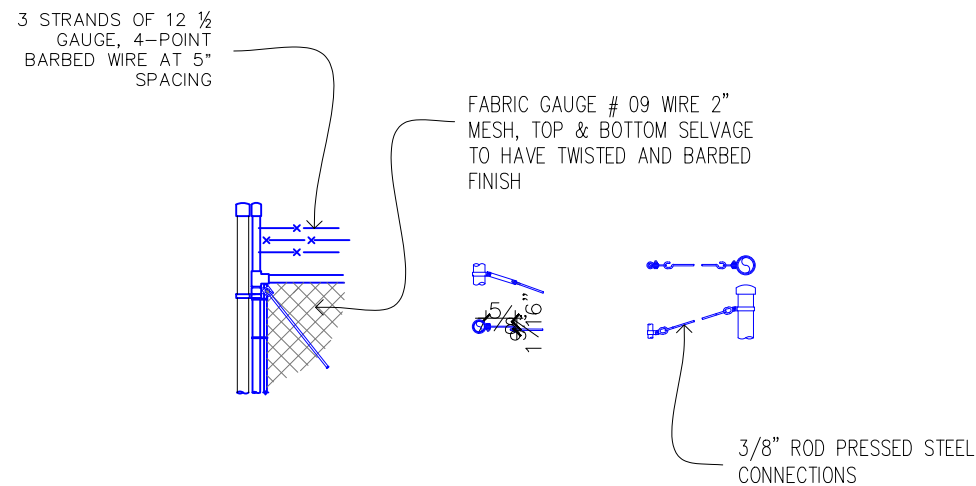

1 FENCE DETAIL
C8 SCALE: NTS

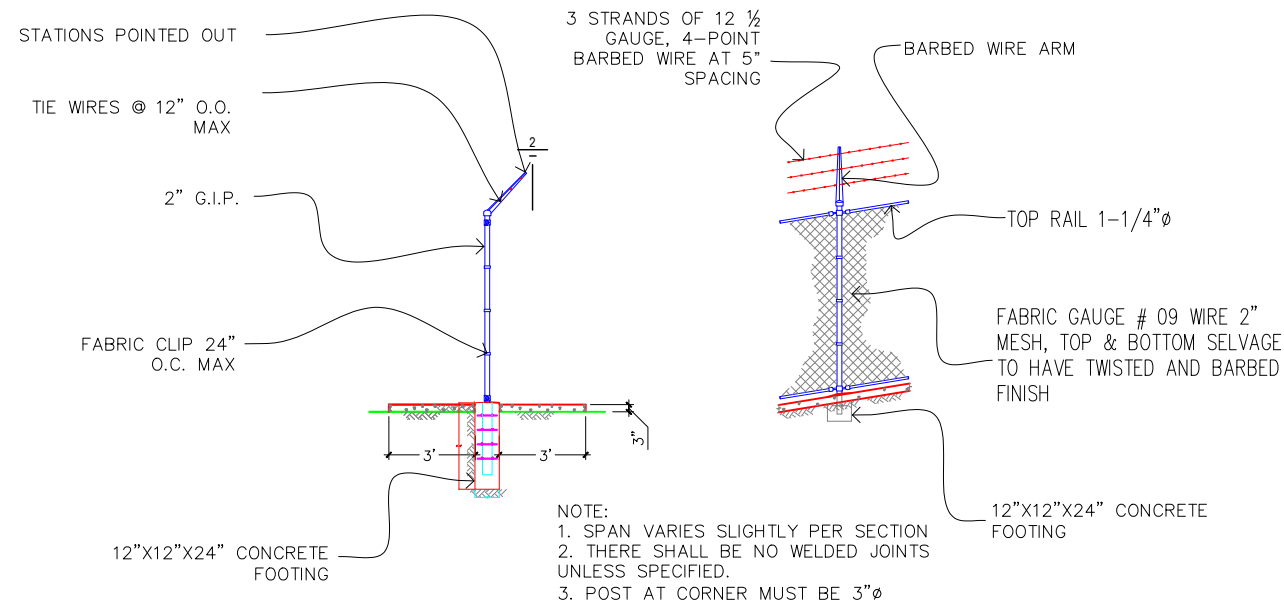

2 FENCE DETAIL
C8 SCALE: 1: 5

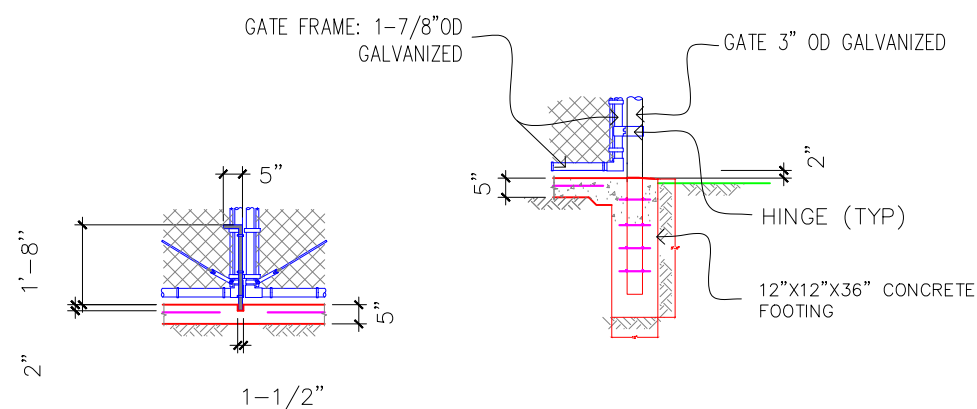

3 FENCE DETAIL
C8 SCALE: NTS

REV. NO.:

REVISION:

CHECKED BY:

APPROVED BY:

DATE:

PREPARED BY:

WATER ENGINEERING

CHECKED BY:

WATER ENGINEERING

APPROVED BY:

W. SWORD, P.E.

ISSUE FOR:

CONSTRUCTION



AMERICAN SAMOA POWER AUTHORITY

ENGINEERING SERVICES DIVISION
TAFUNA, AMERICAN SAMOA

P.O.BOX PPB, PAGO PAGO AM SAMOA 96799. TEL(684) 699-7198, FAX (684) 699-9675

PROJECT NAME:

TURBIDITY PLANT PROJECT

DRAWING TITLE:

FENCE DETAILS

PROJECT LOCATION:

NUU'ULI VILLAGE, AMERICAN SAMOA

SCALE:

NTS

DATE:

OCT2025

PROJECT NO:

SHEET NO.

C9

SIGNATURE:

DATE:

ASTM A36

Chemical Compostion	
Element	content
Carbon, C	0.25 - 0.290 %
Copper, Cu	0.20 %
Iron, Fe	98.0 %
Manganese, Mn	1.03 %
Phosphorous, P	0.040 %
Silicon, Si	0.280 %
Sulfur, S	0.050 %

ASTM A36 Hot Rolled Steel Plate

Mechanical Properties

Metric

Imperial

Tensile Strength, Ultimate

400 - 550 MPa

58000 - 79800 psi

Tensile Strength, Yield

250 MPa

36300 psi

Elongation at Break (in 200 mm)

20.0 %

20.0 %

Elongation at Break (in 50 mm)

23.0 %

23.0 %

Modulus of Elasticity

200 GPa

29000 ksi

Bulk Modulus (typical for steel)

140 GPa

20300 ksi

Poissons Ratio

0.260


0.260

Shear Modulus

79.3 GPa

11500 ksi

Material List			
Part No.	Sepcification	Grade	Remark
GZ1	HI350*150*8*10	A36	
KFZ1	HN300*150*6.5*9	A36	
GL1	HI300*200*6*10	A36	

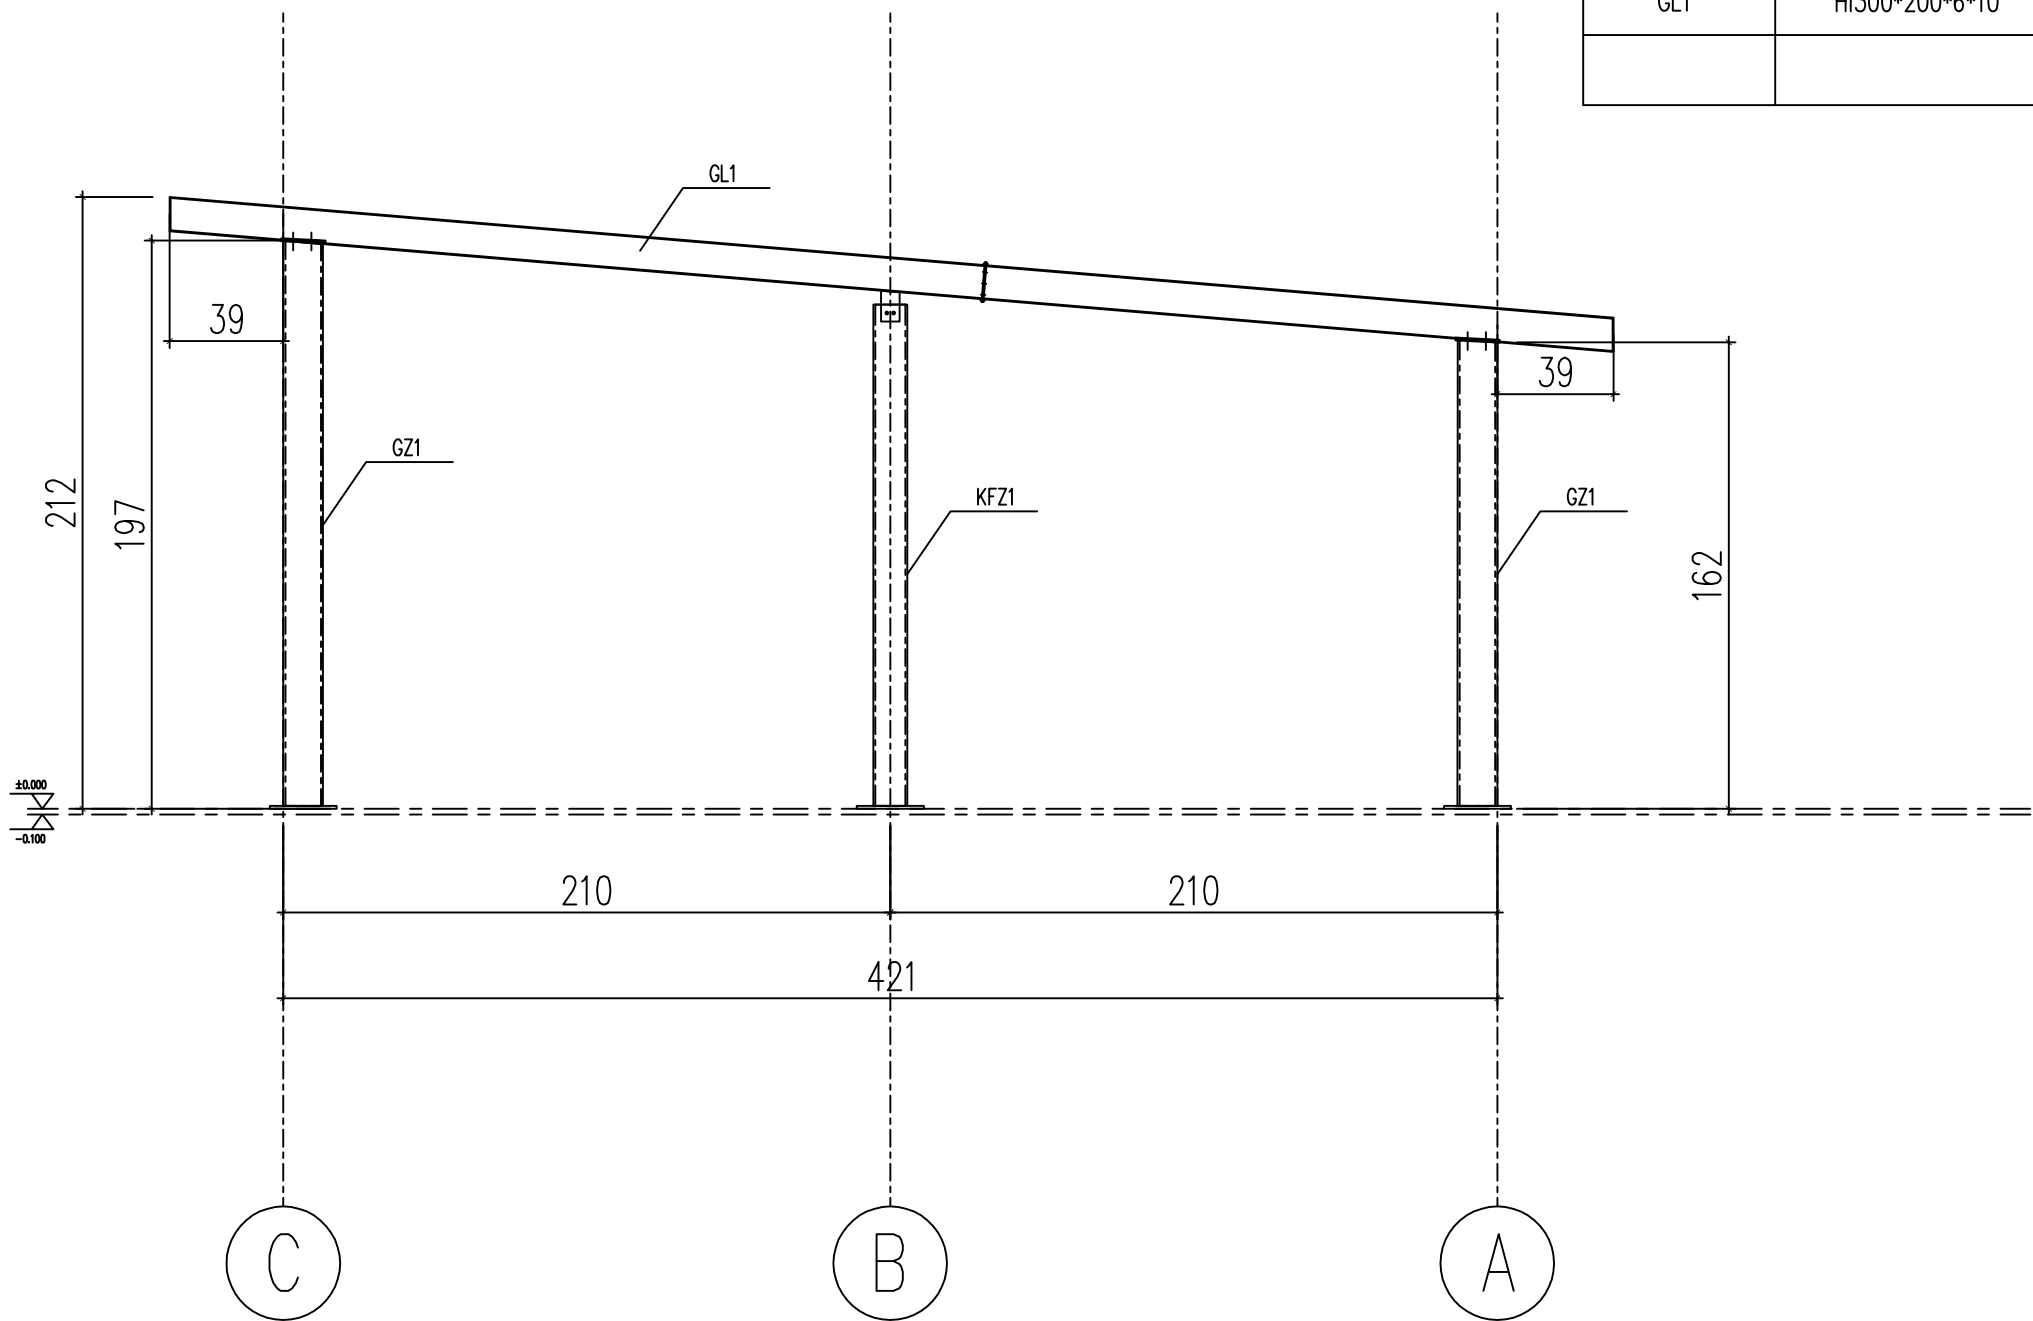


Elevation Plan

GJ1

SUNNYDA HOUSE		Shanghai Sunnyda Industry Co., Ltd.		
Project Name	Item	Project No.	Designer	Proportion
		Category	Date	Page

Material List			
Part No.	Sepecification	Grade	Remark
GZ1	HI350*150*8*10	A36	
KFZ1	HN300*150*6.5*9	A36	
GL1	HI300*200*6*10	A36	

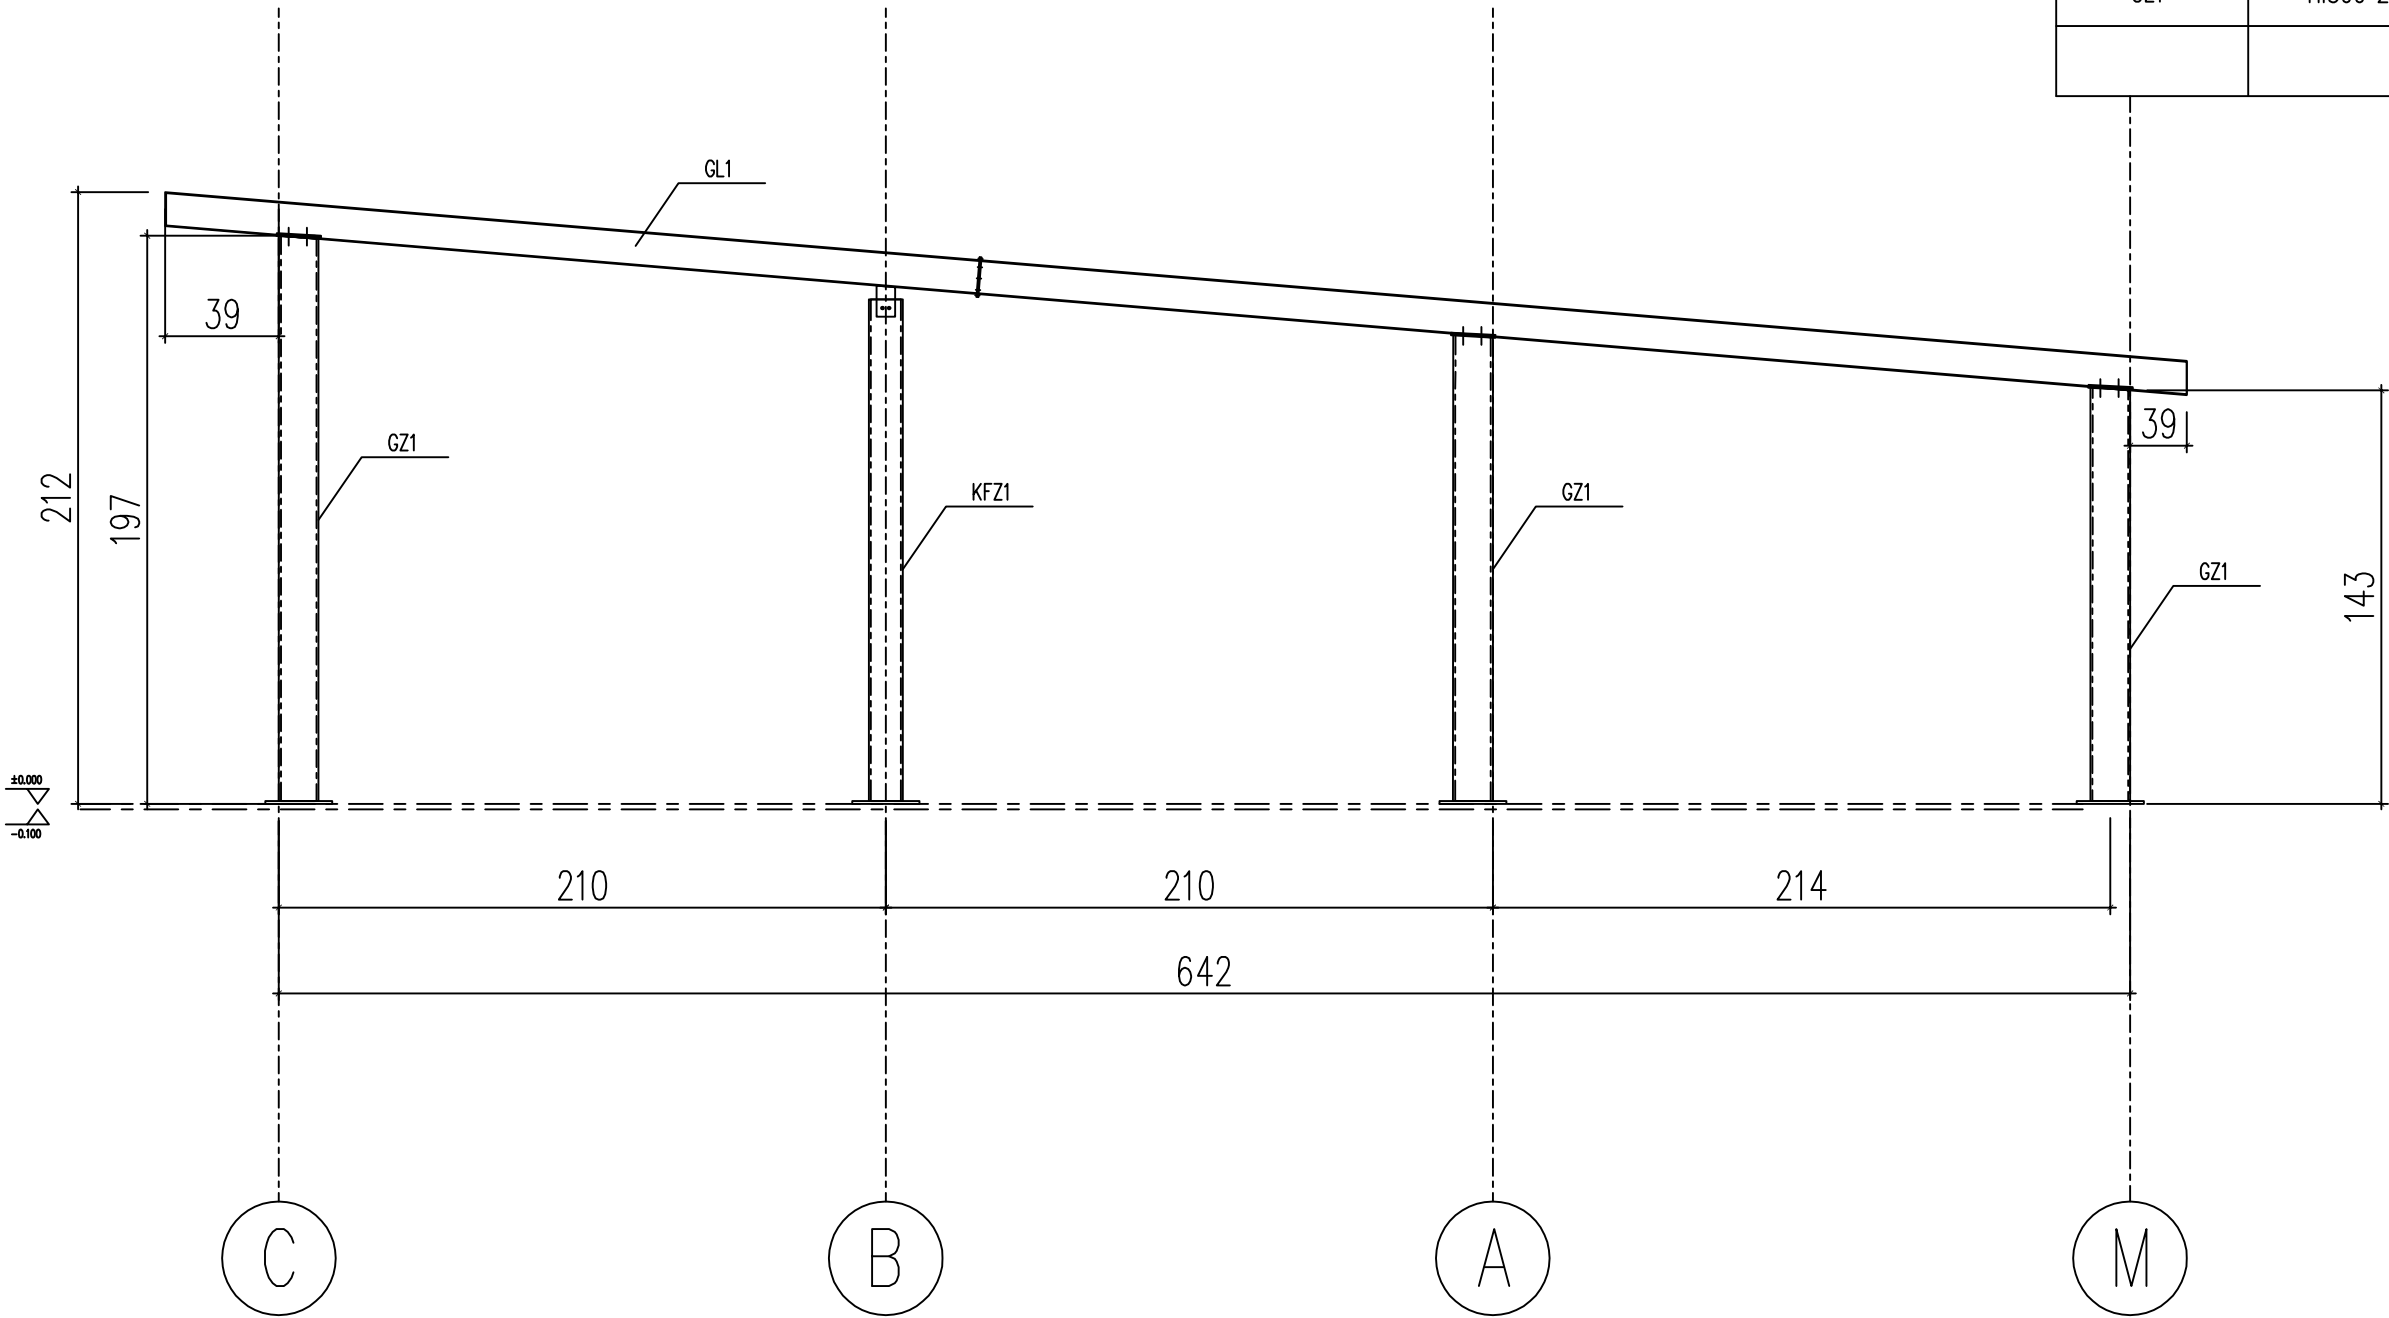


Elevation Plan

GJ3

SUNNYDA HOUSE	Shanghai Sunnyda Industry Co., Ltd.			
Project Name	Item	Project No.	Designer	Proportion
		Category	Date	Page


Material List			
Part No.	Sepecification	Grade	Remark
GZ1	HI350*150*8*10	A36	
GL1	HI300*200*6*10	A36	

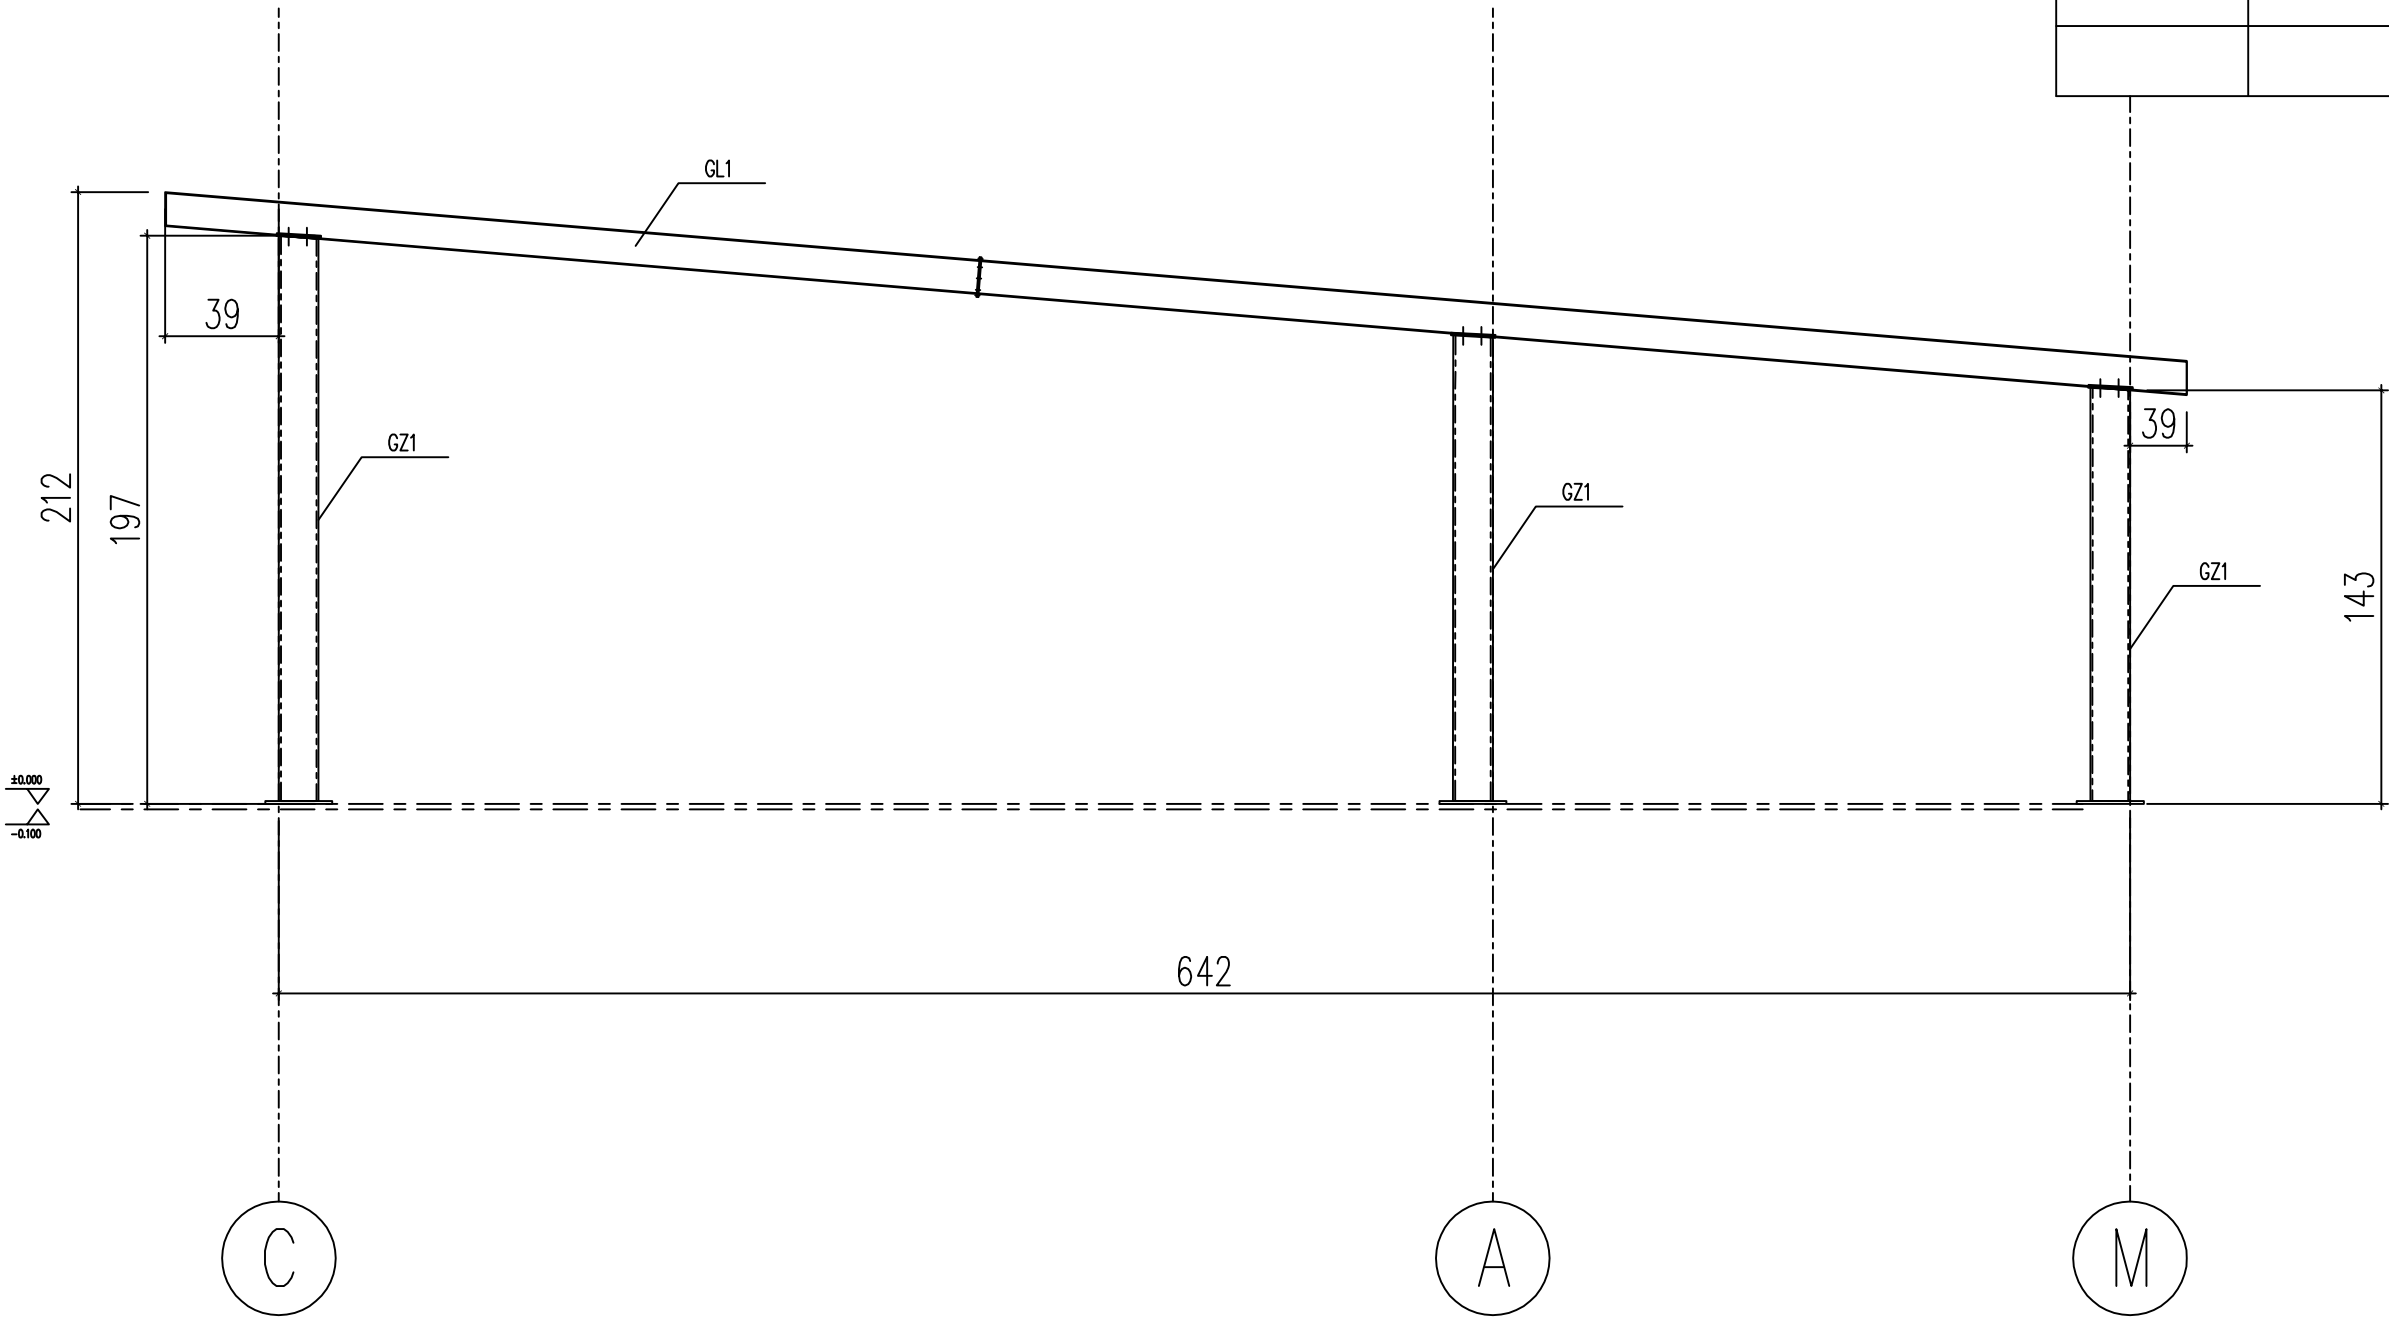


Elevation Plan

GJ4

SUNNYDA HOUSE	Shanghai Sunnyda Industry Co., Ltd.			
Project Name	Item	Project No.	Designer	Proportion
		Category	Date	Page

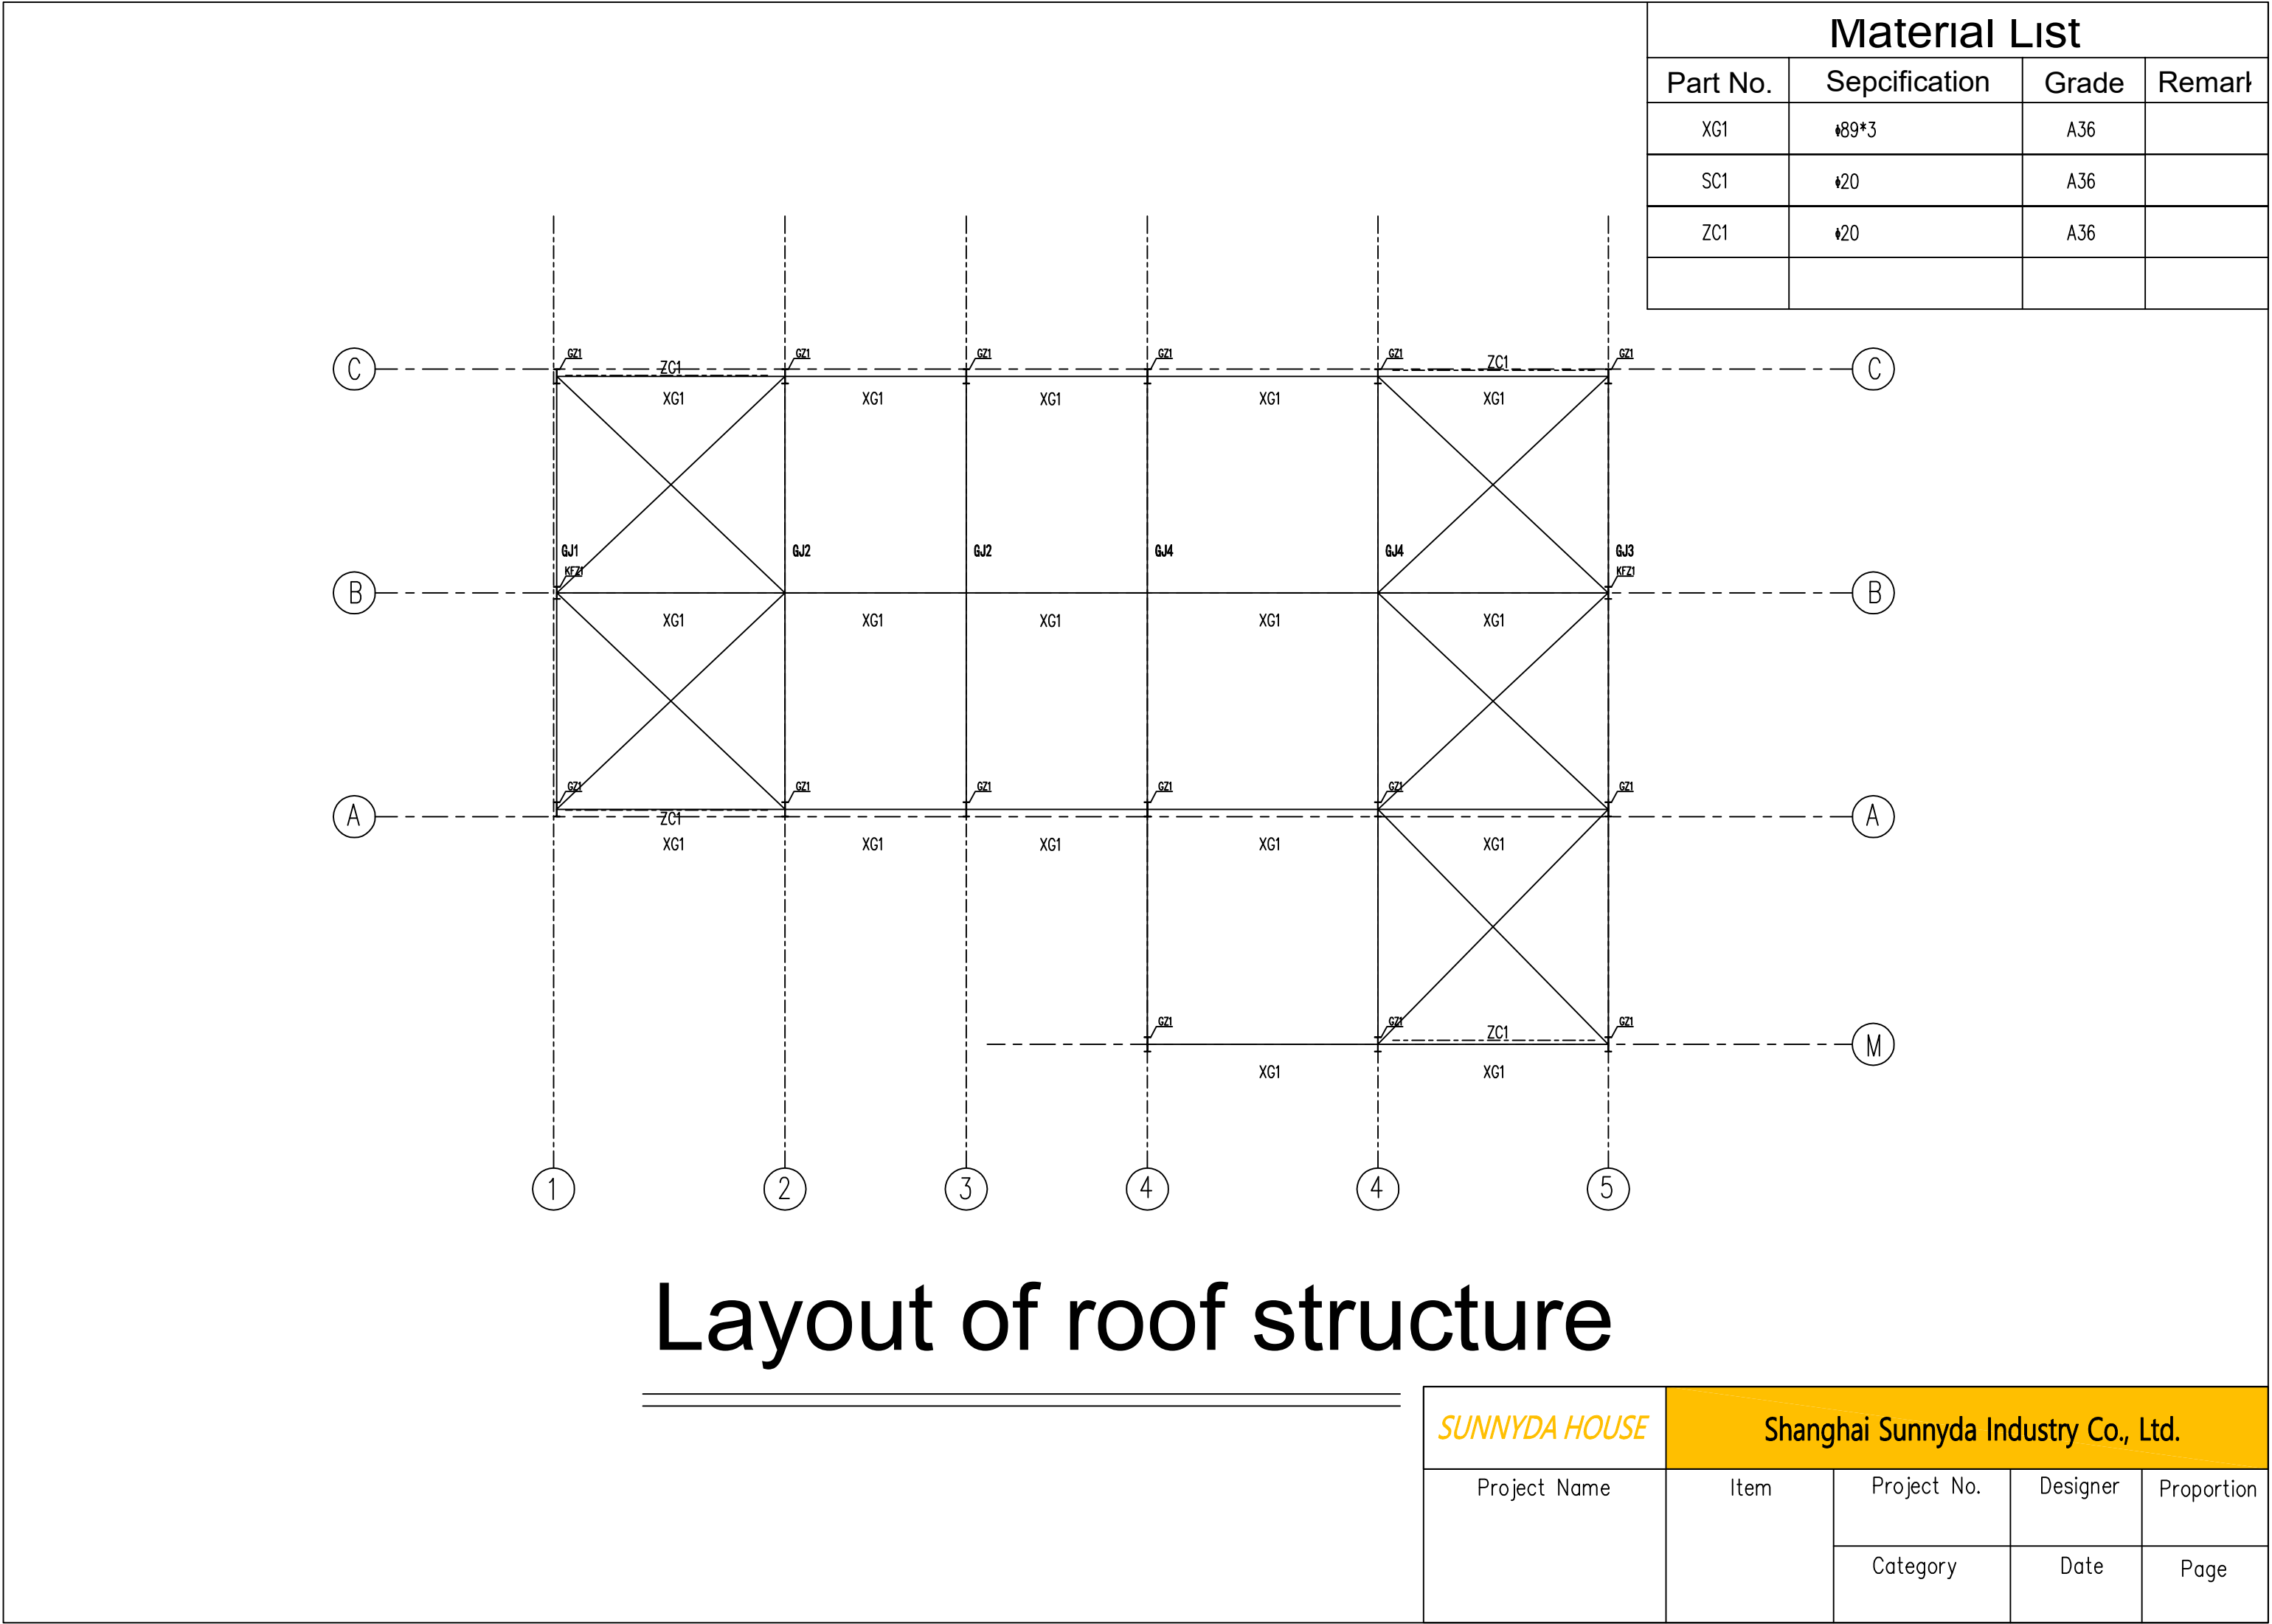

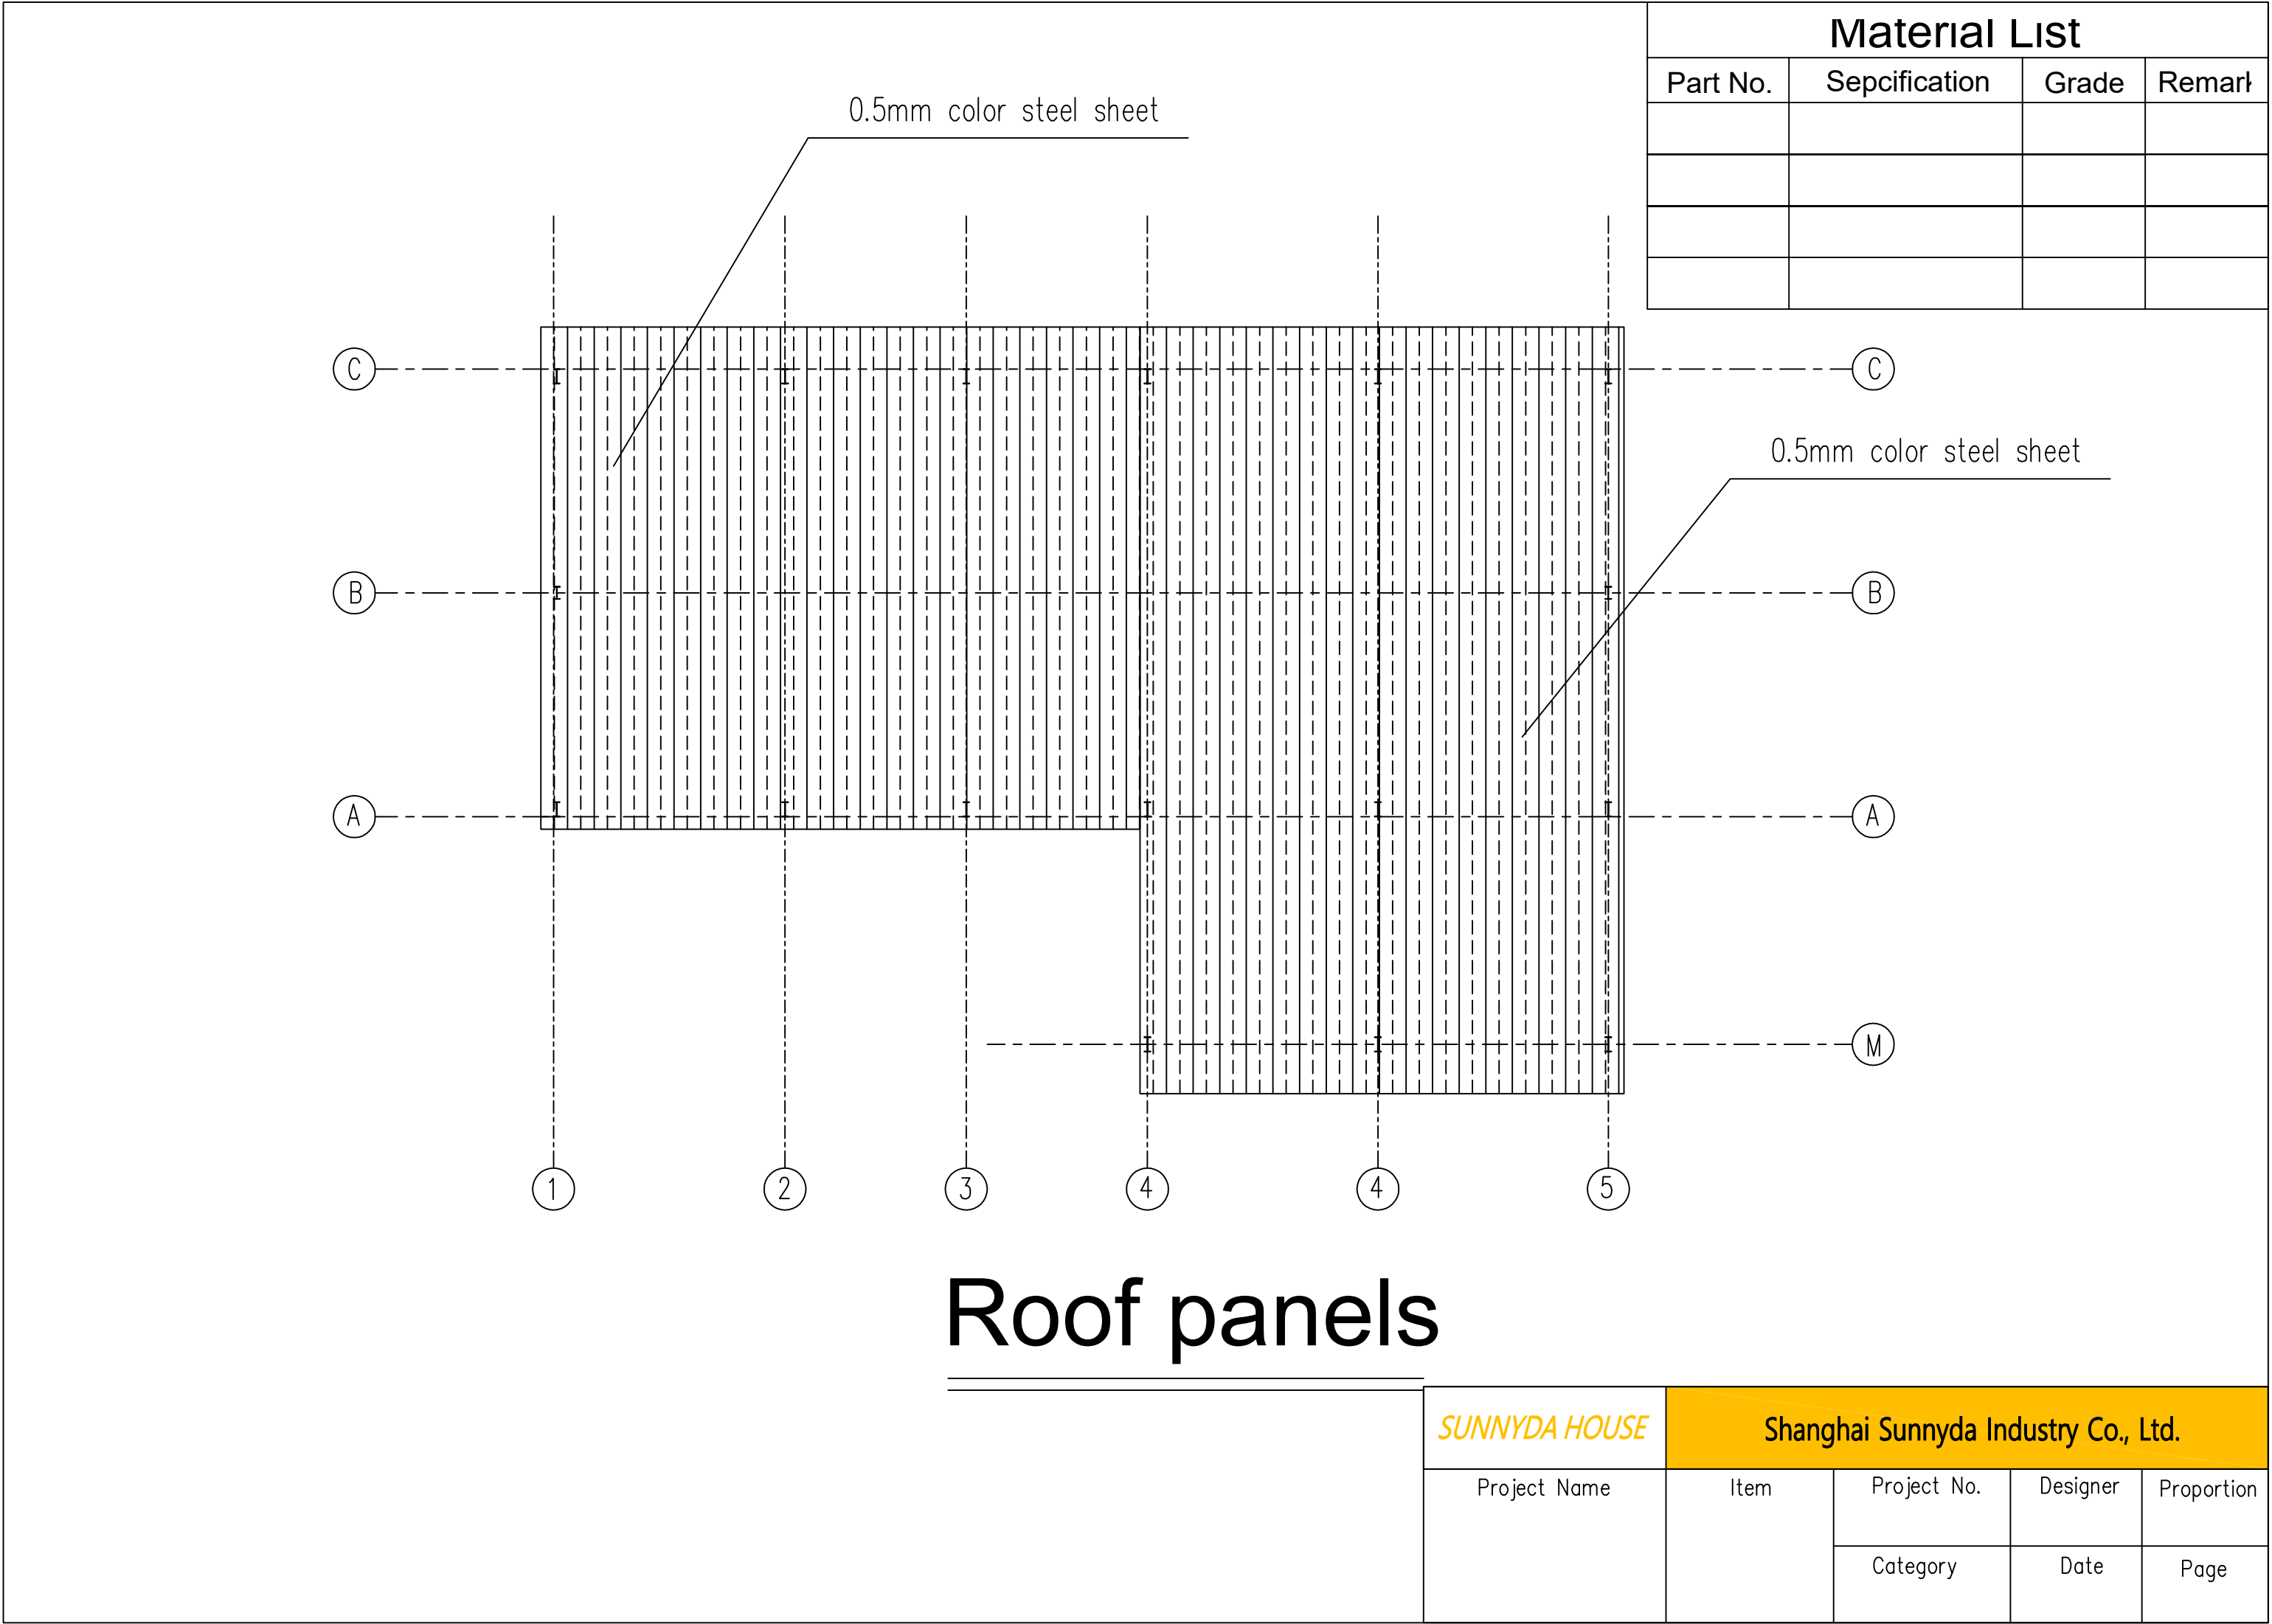


Roof panels




GRATING IN GUTTER
OUT OF SUEZ SCOPE

REV	17/03/2024	V.DJVAL	C.DAGUET	FIRST ISSUE
DATE	DRAWN	CHECKED	MODIFICATION	
SCALE 1:50	WATER TREATMENT PLANT - PLAN VIEW DRAWING FOR CIVIL WORK STUDIES			
 				
 ALL RIGHTS RESERVED FOR ALL COUNTRIES DEPARTEMENT UNITE COMPACT DEGRADATION 16, Place de l'Il 92040 PARIS LA DEFENSE				
SIZE:	A0	REFERENCE:	R24 0003	DRAWING N°: 800A REV a


SECTION A-A

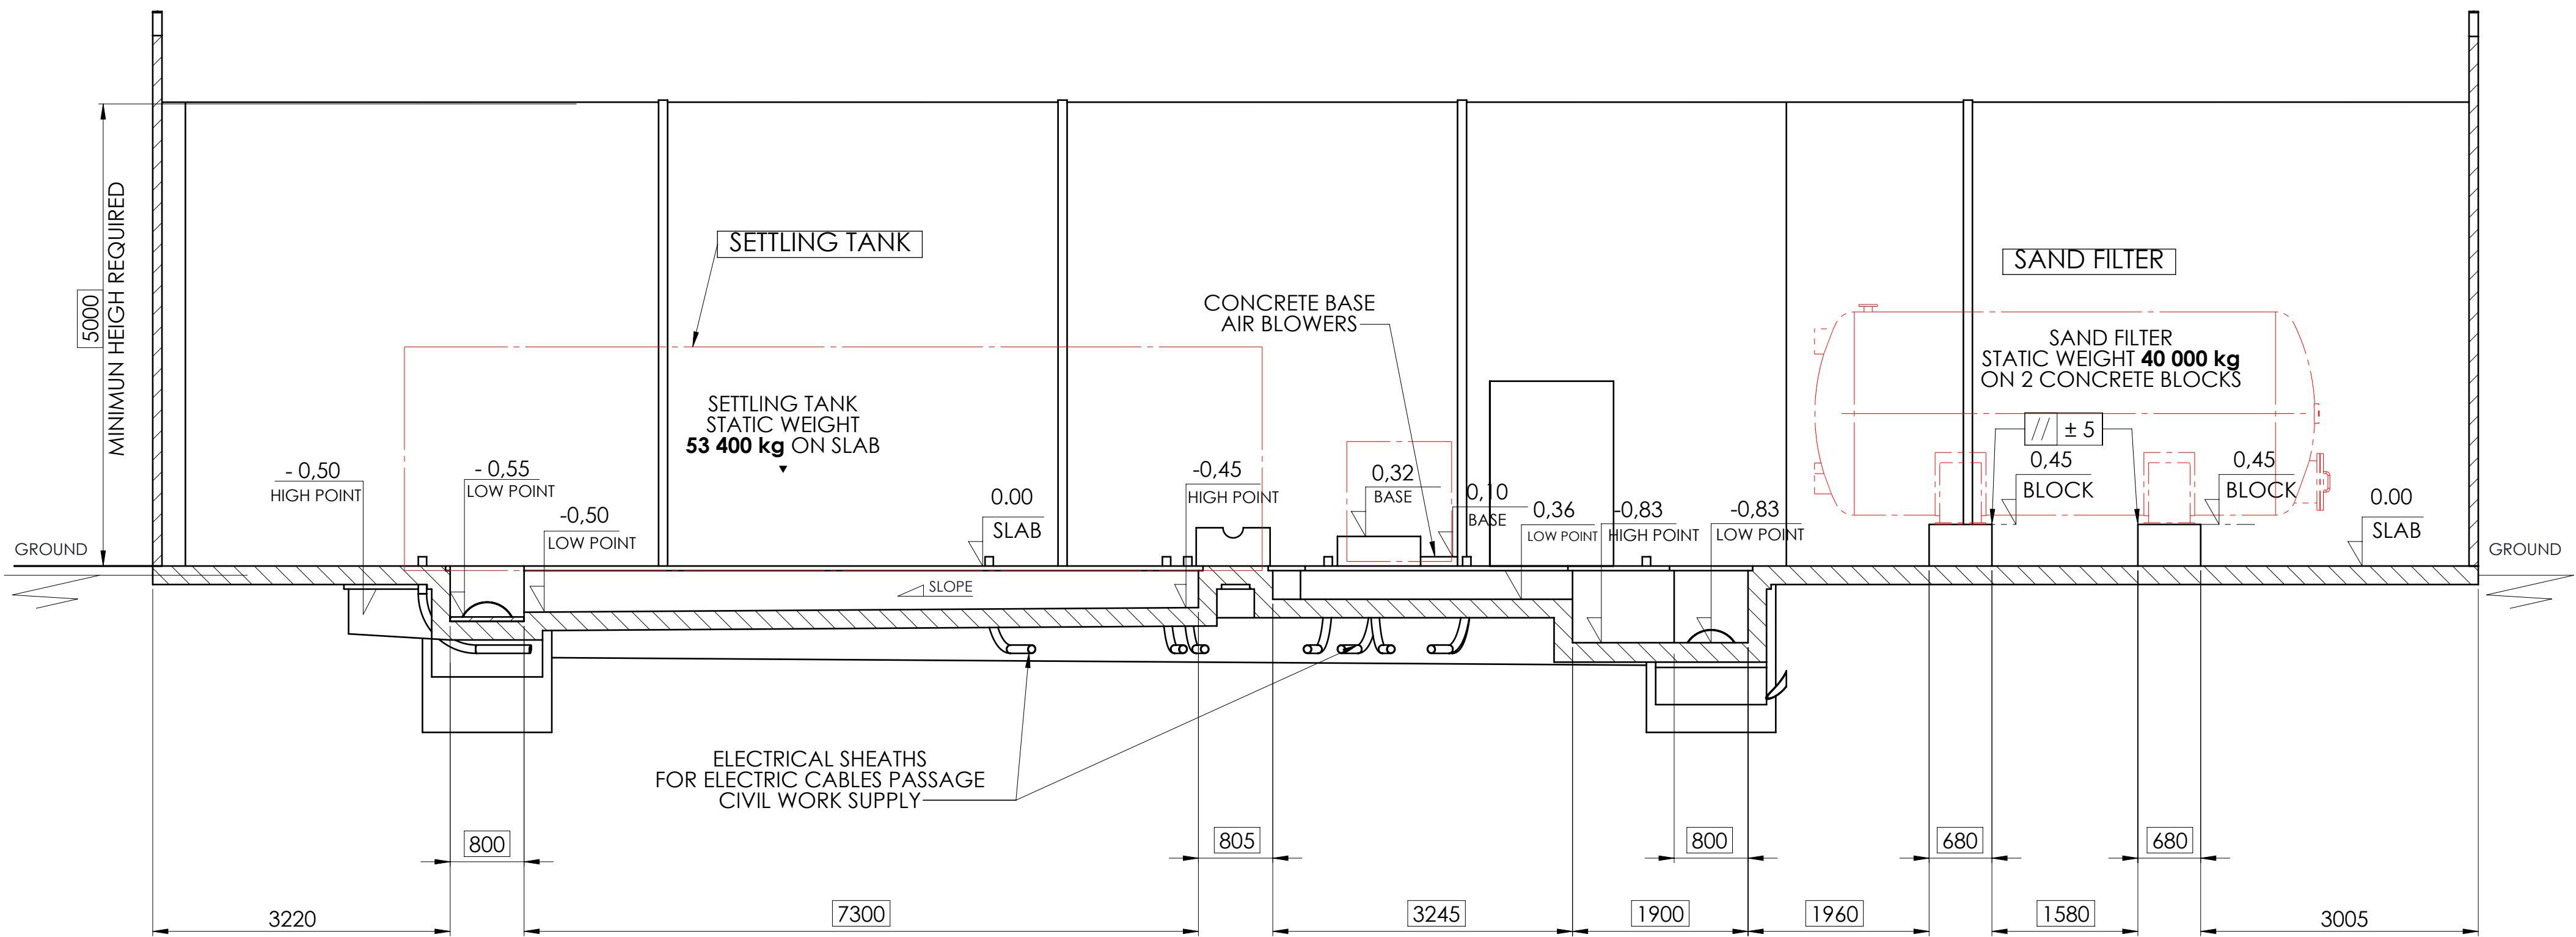

SECTION B-B

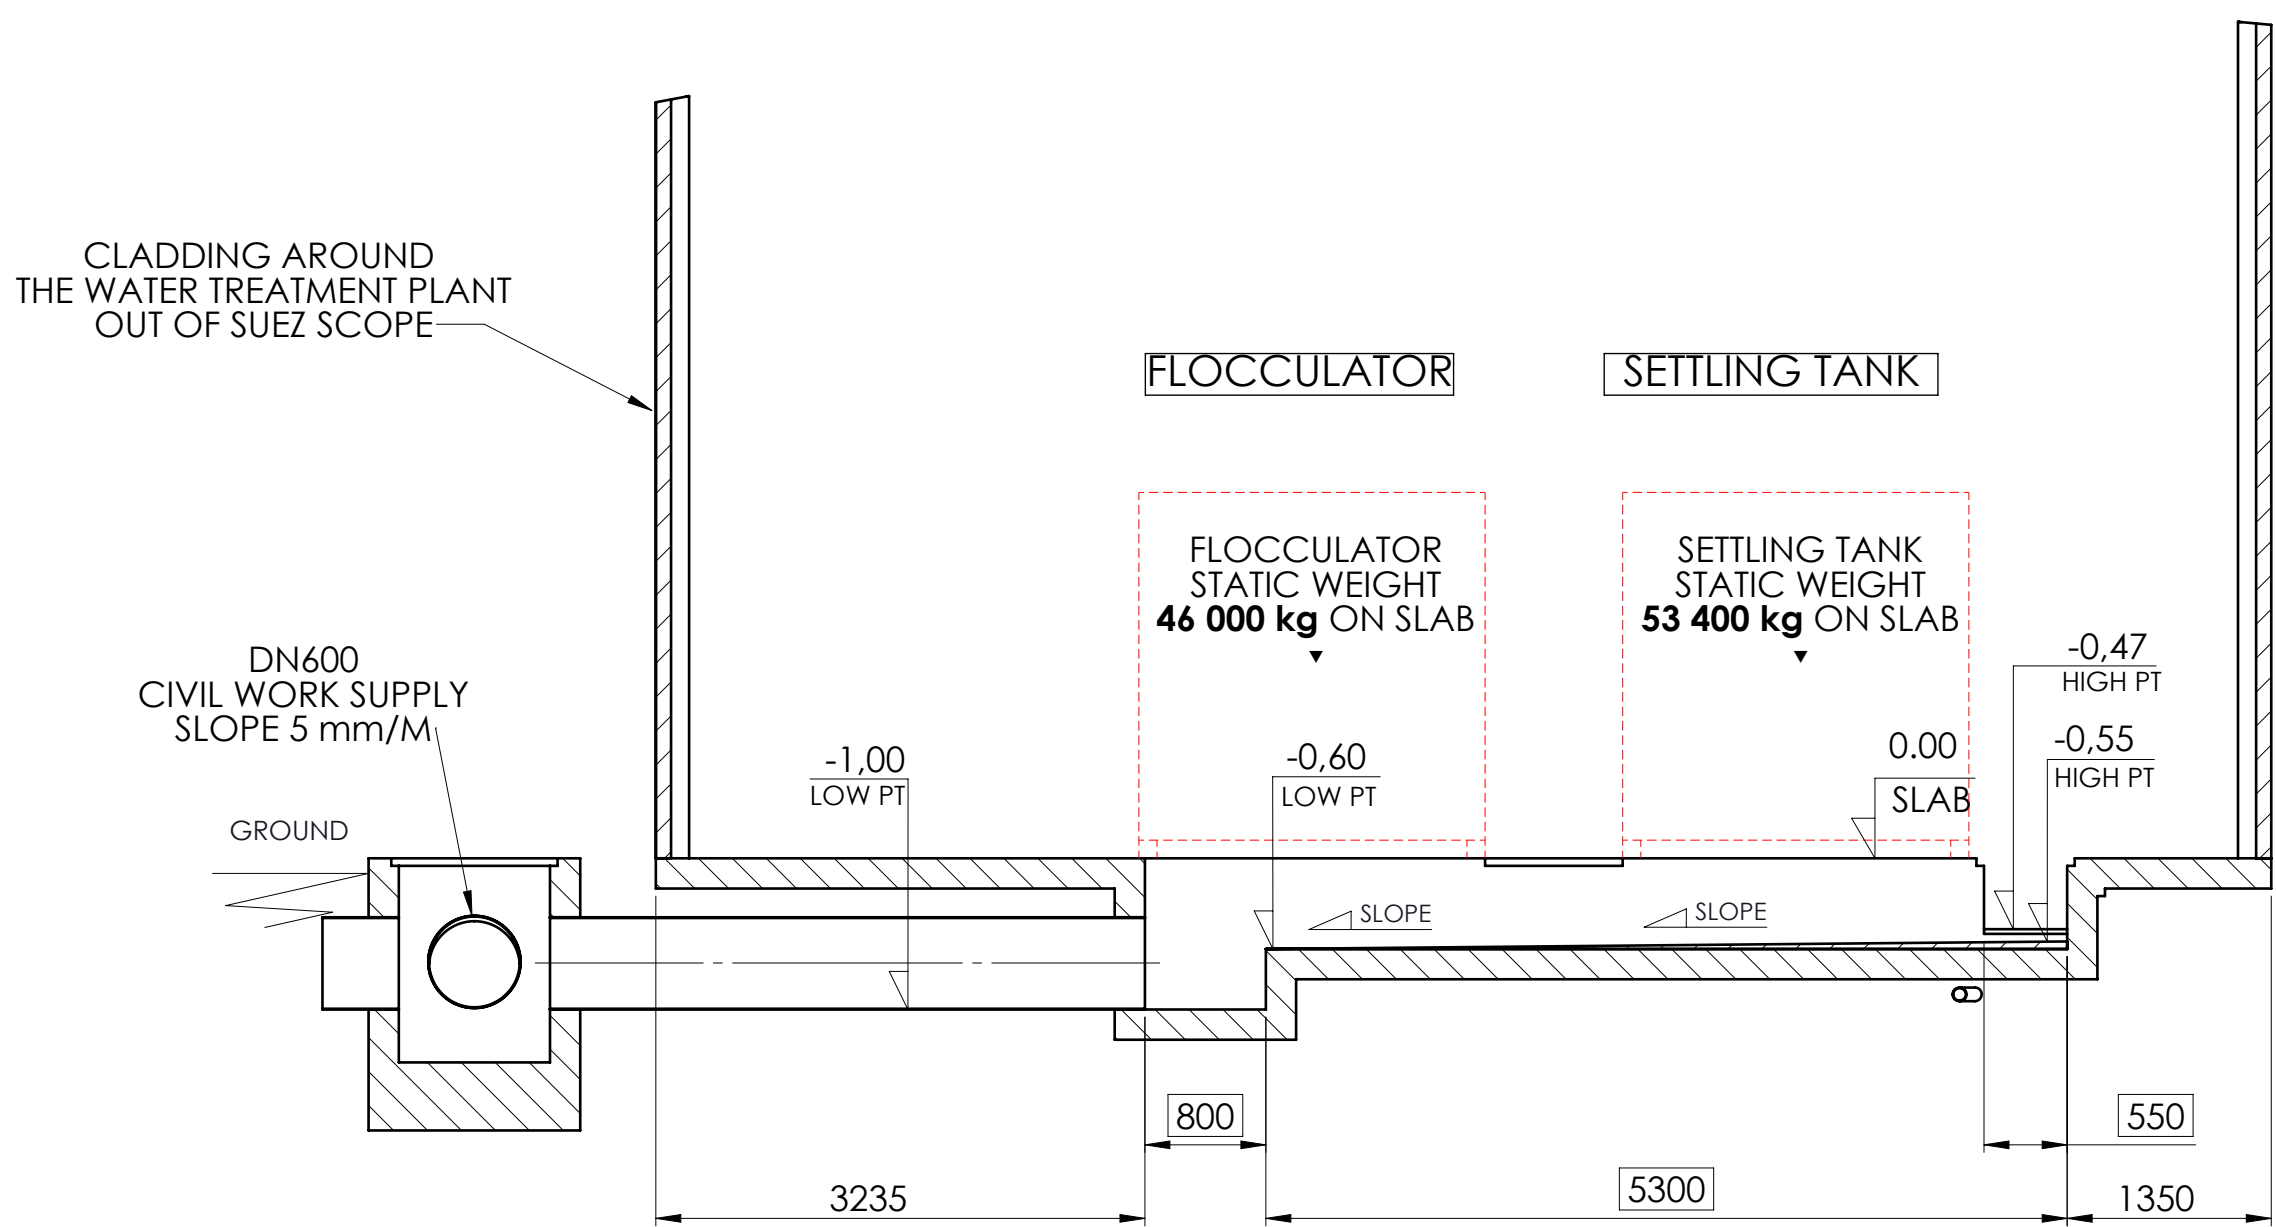

SECTION C-C

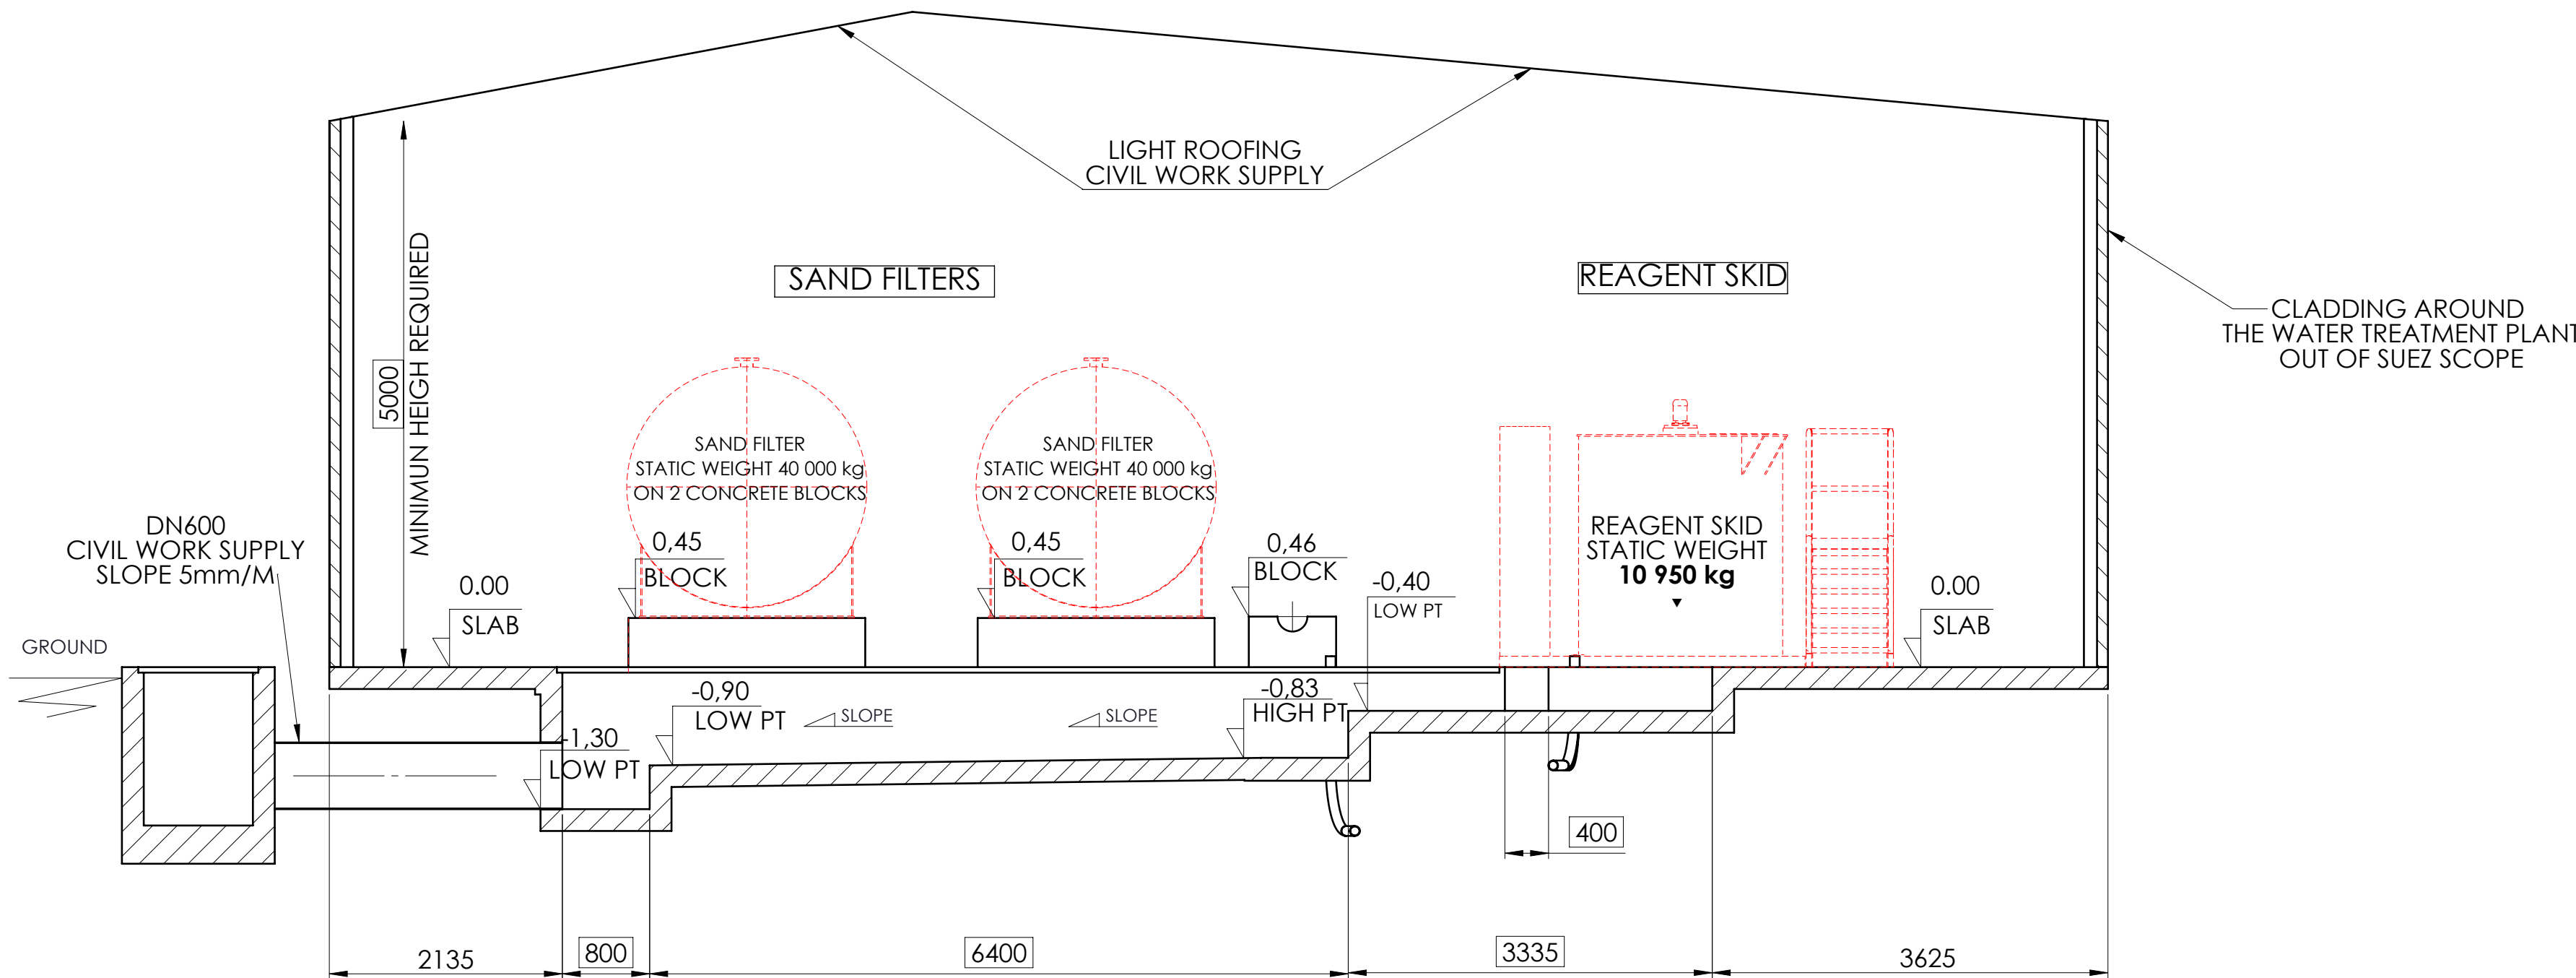

**NOTE CONCERNING
THE CONSTRUCTION OF CIVIL ENGINEERING**

1) GENERAL DATA

ALL DIMENSIONS ARE IN MILLIMETERS AND LEVELS IN METERS TAKING THE FINISHING RENDERING INTO ACCOUNT. THE RETAINING STRUCTURES WHICH ARE NOT BUILT OF CONCRETE WITH INTEGRAL WATERPROOFING SHALL BE INTERNALLY COATED WITH A SUITABLE COMPOUND SO THAT THEY ARE ABSOLUTELY WATERPROOF.

2) STABILITY AND RESISTANCE OF STRUCTURES

ALL STRUCTURES SHALL BE SO DESIGNED THAT, WHEN EMPTY, THEY RESIST THE UPTHURST. REGARDLESS OF STATIC OR DYNAMIC INTERNAL LOADS. A CELL MAY BE FULL AND THE OTHER EMPTY, AND VICE VERSA.

3) TOLERANCES


MAXIMUM DIFFERENTIAL SETTLEMENT BETWEEN ANY TWO POINTS OF THE STRUCTURE = **30 mm**.
MAXIMUM DIFFERENTIAL SETTLEMENT BETWEEN ANY TWO POINTS ON AND BETWEEN THE BLOCKS OF THE FILTERS = **10 mm**.

DIMENSIONS
TO BE CHECKED

2075

SECTION D-D
SCALE 1:20


M2 CONCRETE BLOCK SUPPORT RAW WATER INLET PIPE

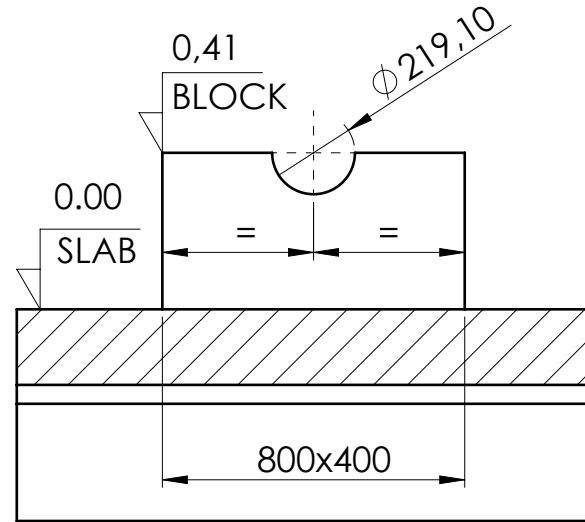

AFTER ERECTION TIME 1 CONCRETE BLOCKS FOR PIPE DN200
STATIC WEIGHT 1000 kg

SECTION E-E
SCALE 1:20


M1 CONCRETE BLOCK SUPPORT FLOCCULATORS PIPE

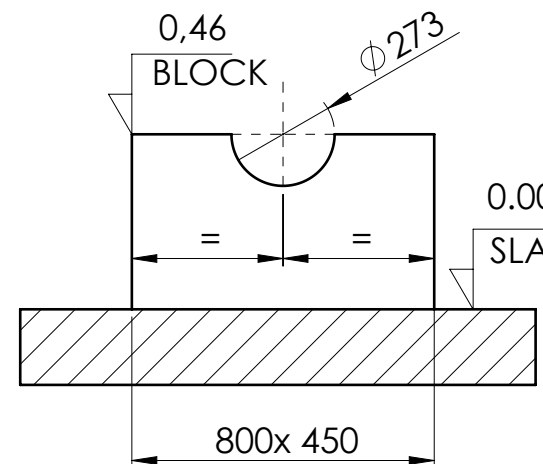

AFTER ERECTION TIME 2 CONCRETE BLOCKS FOR PIPE DN250
STATIC WEIGHT 1000 kg


SECTION F-F
SCALE 1:20

2 CONCRETE BASES CENTRIFUGAL PUMPS

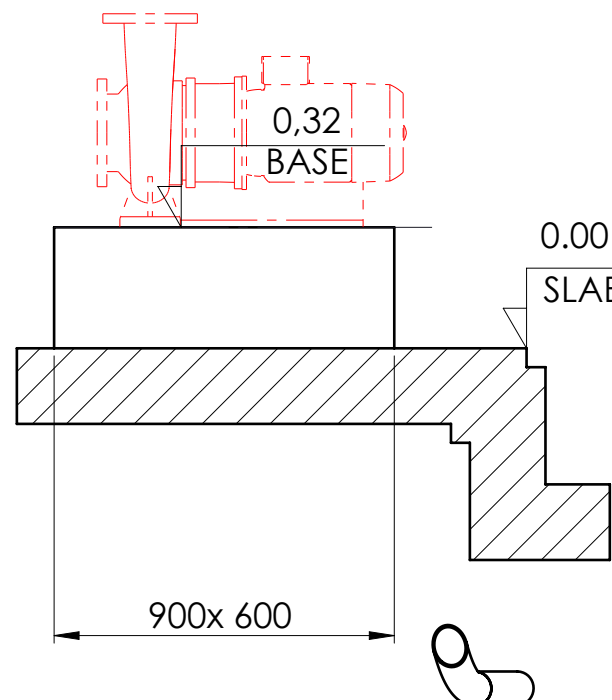

SECTION G-G
SCALE 1:20

2 CONCRETE BASES AIR BLOWERS

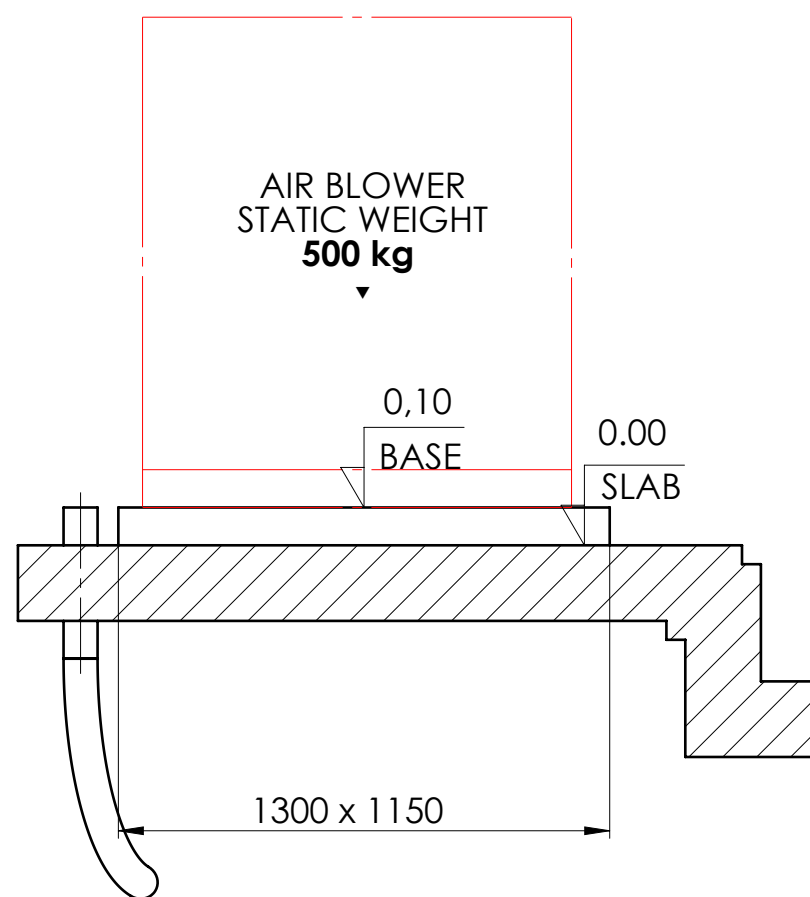

SAMOA ISLANDS

600 + 200 gpm

REV.	DATE	V. DUVAL	C. DAGUET	FIRST ISSUE
REV.	DATE	DRAWN	CHECKED	MODIFICATION
SCALE:	1:50			
SIZE:	A0	REFERENCE:	R24 0003	REV. Q
		DRAWING N°:	800B	

WATER TREATMENT PLAT - SECTIONS
DRAWING FOR CIVIL WORKS STUDIES

ALL RIGHTS RESERVED FOR ALL COUNTRIES
DEPARTEMENT UNITE COMPACT DEGRANDMONT
16 place de la
92040 LE DÉSERT

suez

**NOTE CONCERNING
THE CONSTRUCTION OF CIVIL ENGINEERING**

1) GENERAL DATA

ALL DIMENSIONS ARE IN MILLIMETERS AND LEVELS IN METERS TAKING THE FINISHING RENDERING INTO ACCOUNT
THE RETAINING STRUCTURES WHICH ARE NOT BUILT OF CONCRETE WITH INTEGRAL WATERPROOFING SHALL BE INTERNALLY COATED WITH A SUITABLE COMPOUND SO THAT THEY ARE ABSOLUTELY WATERPROOF

2) STABILITY AND RESISTANCE OF STRUCTURES

ALL STRUCTURES SHALL BE SO DESIGNED THAT, WHEN EMPTY, THEY RESIST THE UPRHURST, REGARDLESS OF STATIC OR DYNAMIC INTERNAL LOADS
A CELL MAY BE FULL AND THE OTHER EMPTY, AND VICE VERSA

3) TOLERANCES

MAXIMUM DIFFERENTIAL SETTLEMENT BETWEEN ANY TWO POINTS OF THE STRUCTURE AND PER SLAB PORTION (DELIMITED BY EXPANSION JOINTS) = **30.mm**

4) EARTHING SYSTEM

— BARE COPPER 35.mm²

⚡ EARTHING SYSTEM OUTLET

===== BAR FOR EARTH CONNECTION OF ALL METAL STRUCTURE


5) PVC CABLE SHEATHS FOR ELECTRICAL CABLES PASSAGE

① PVC CABLE SHEATH DIA.63 (G.C SUPPLY) RADIUS 500 mini

② PVC CABLE SHEATH DIA.90 (G.C SUPPLY) RADIUS 600 mini

③ PVC CABLE SHEATH DIA.200 (G.C SUPPLY) RADIUS 1300 mini

SECTION A-A
SCALE 1:25
DRAW PIT AND ELECTRICAL SHEATH

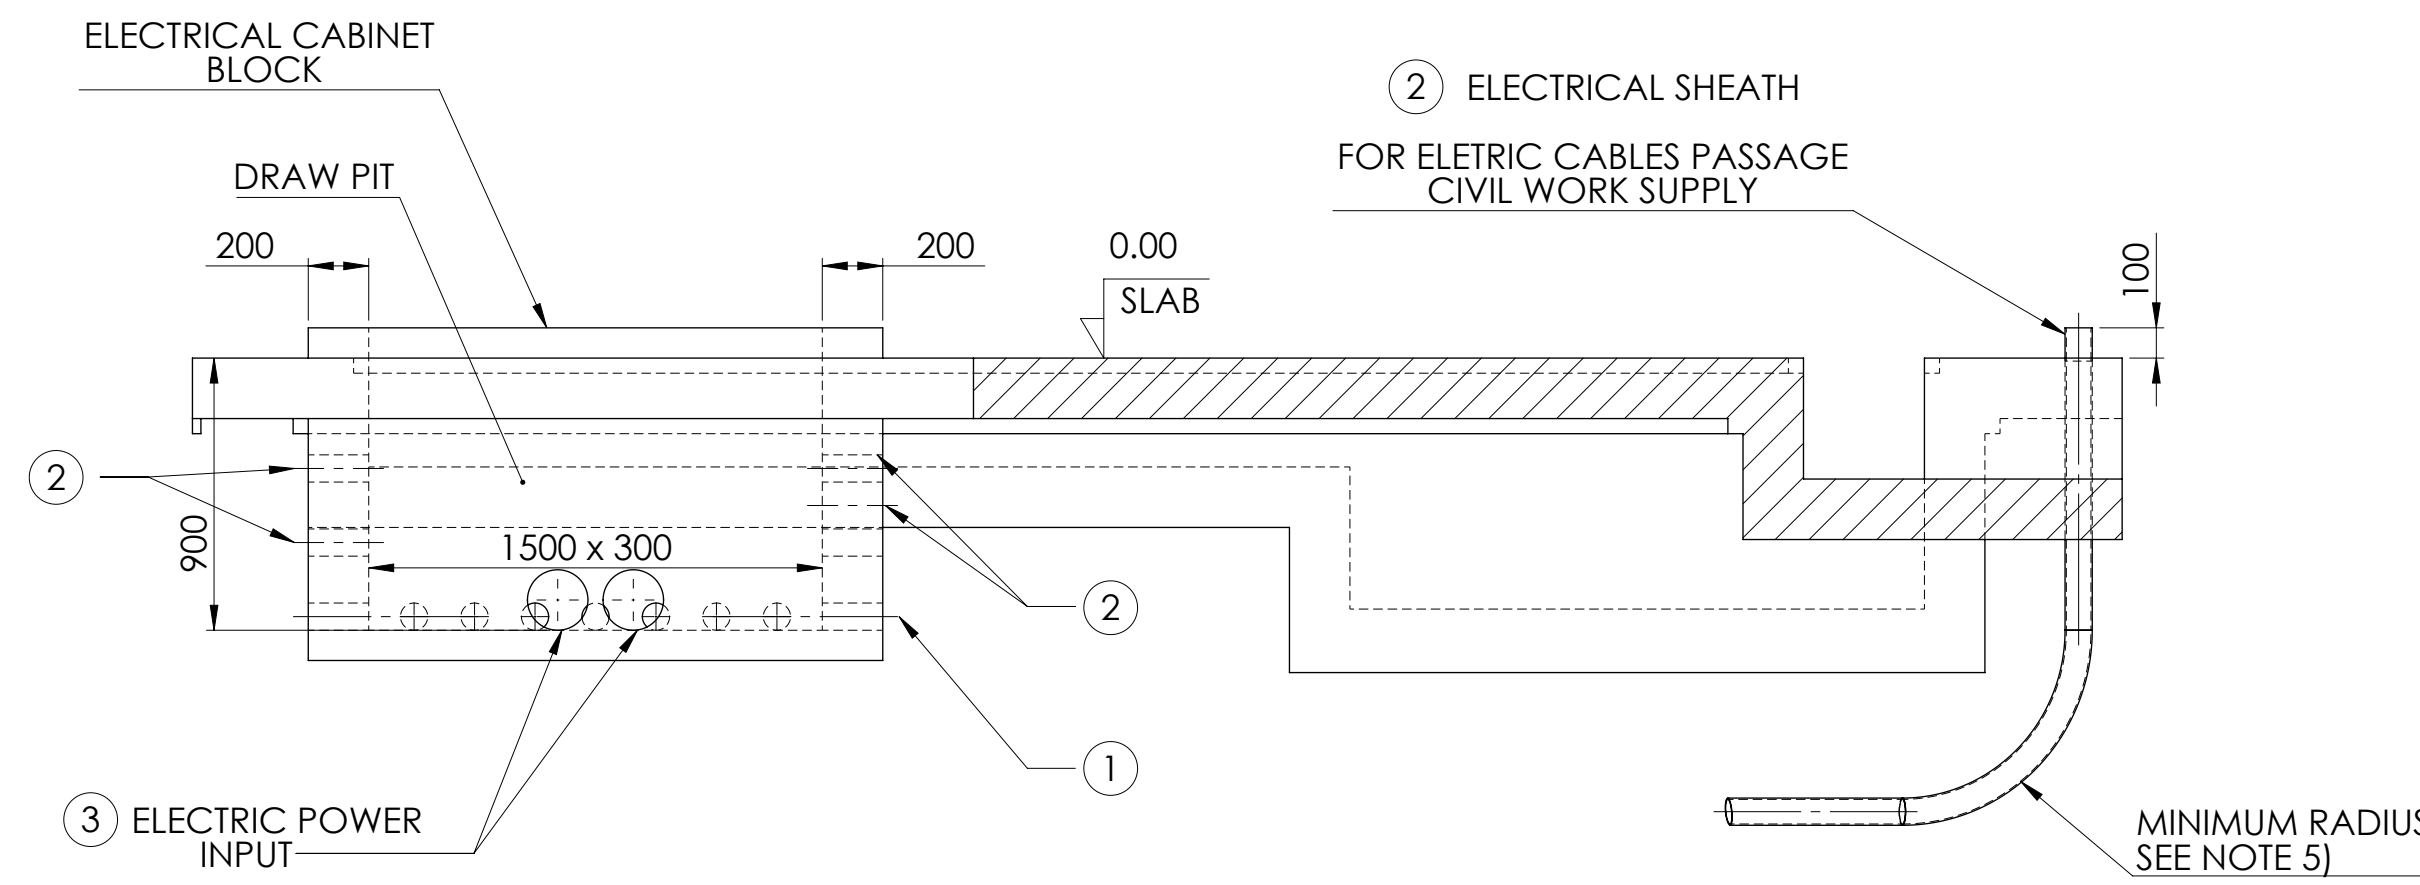

SAMOA ISLANDS
600 + 200 gpm

α	17/07/2024	V.DUVAL	C.DAGUET	FIRST ISSUE			
REV.	DATE	DRAWN	CHECKED	MODIFICATION			
SCALE: 1:50	WATER TREATMENT PLANT - ELECTRICAL SHEATHS DRAWING FOR CIVIL WORK STUDIES						
 							
ALL RIGHTS RESERVED FOR ALL COUNTRIES							
DEPARTEMENT UNITE COMPACT DEGRÉMENT							
185 av. du 18 juin 1946							
92500 RUEIL MALLAISON							
SIZE: A0	REFERENCE: R24 0003	DRAWING N°: B00C	REV α				