


REFERENCE DRAWINGS:

SK-02	ADSS SHORT SPAN TENSION ASSEMBLY
SK-06	ADSS CONSTRUCTION SCHEDULE
SK-12	ADSS PROJECT MATERIAL SCHEDULE


MATERIALS LIST - BOLTED ASSEMBLY		
TAG NO.	ITEM	QTY
1	CABLE STORAGE BRACKET	1
2	M16 BOLT AND NUT	2
3	M16 WASHER	4
4	DOWNLEAD CUSHION CLAMP	AS REQ
5	STAINLESS STEEL STRAPPING	AS REQ
6	CABLE ABRASION PROTECTOR	2

MATERIALS LIST - BANDED ASSEMBLY		
TAG NO.	ITEM	QTY
7	CABLE STORAGE BRACKET	1
8	19mm GALV STAINLESS STEEL BAND & BUCKLE	2
9	DOWNLEAD CUSHION CLAMP	AS REQ
10	CABLE ABRASION PROTECTOR	2
11	STAINLESS STEEL STRAPPING	AS REQ

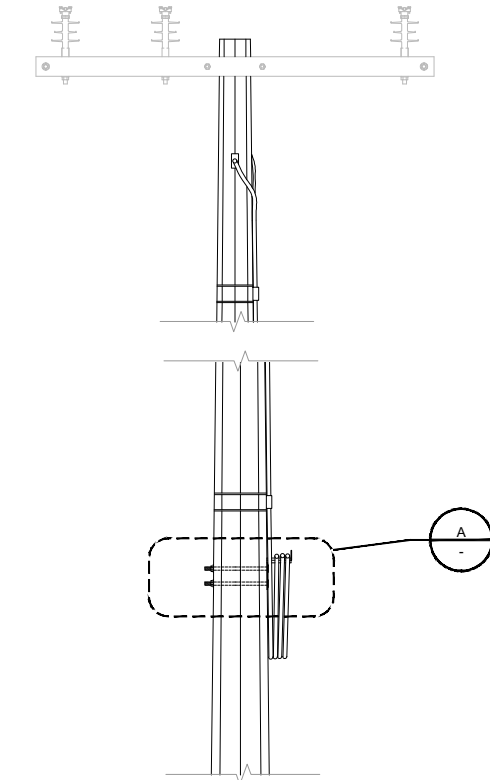


LONGITUDINAL FACE - BOLTED ASSEMBLY

SCALE 1:20

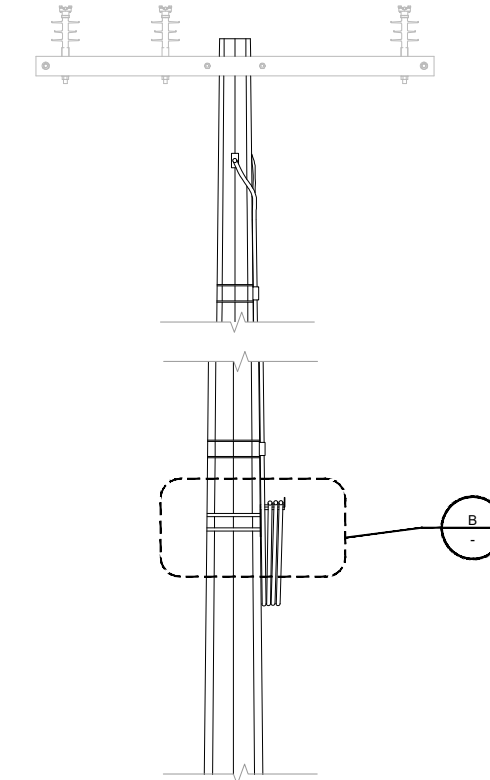


LONGITUDINAL FACE - BANDED ASSEMBLY

SCALE 1:20

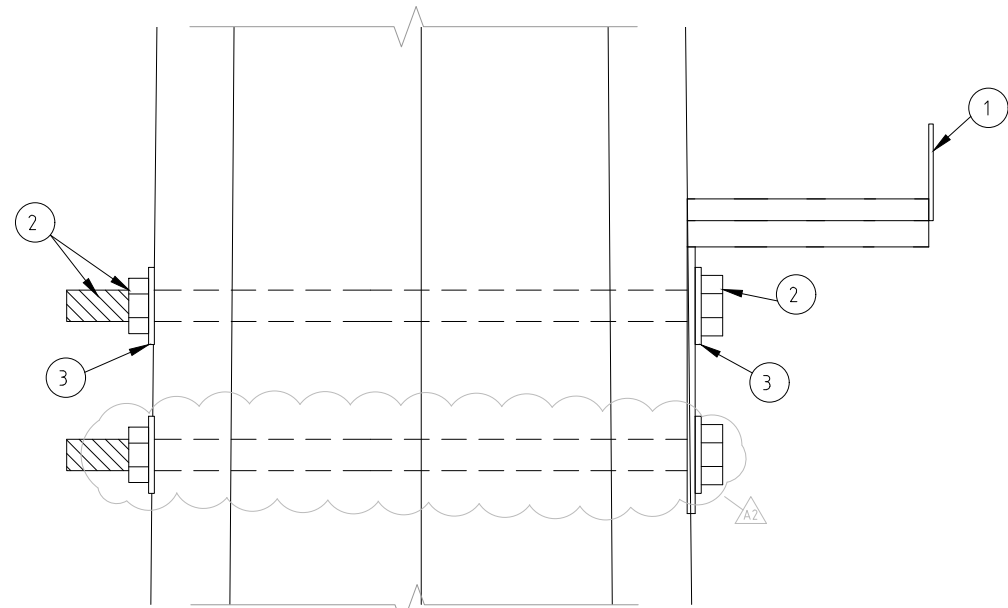

DETAIL A

SCALE 1:2

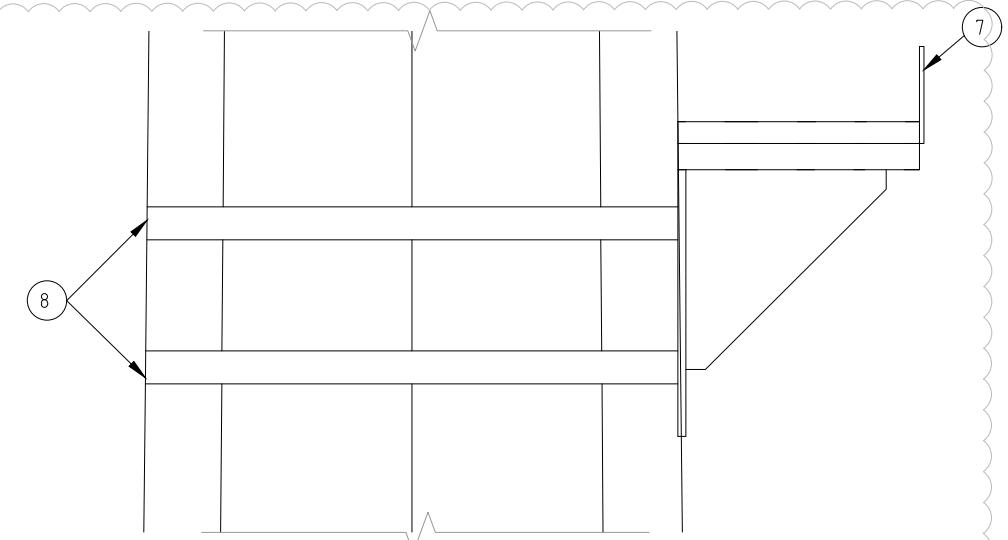

DETAIL B

SCALE 1:2

NOTES

- REFER TO SK-02 FOR TENSION ASSEMBLY DETAILS.
- MAXIMUM SPACING FOR DOWNLEAD CUSION IS 900mm
- REFER TO MATERIAL SCHEDULE (SK-12) FOR THE RECOMMENDED STOCK CODE ITEM.
- CABLE STORAGE SHALL BE LOCATED A MAXIMUM HEIGHT OF 7m ABOVE GROUND LEVEL FOR EASE OF INSTALLATION.
- CUSHION CLAMPS RECOMMENDED TO BE SPACED 800mm APART AS SHOWN, WITH A MAXIMUM SPACING OF 900mm.

CONTRACTOR



DESIGNED	KC	24.07.2020
CHECKED	JD	24.07.2020
DRAWN	KC	24.07.2020
CHECKED	JD	24.07.2020
APPROVED	IK	24.07.2020
A3 SCALE: AS SHOWN		

PROJECT NAME

ADSS LINE DESIGN ON EXISTING 11kV LINE - EAST HONIARA

PROJECT DESCRIPTION

EASTERN NETWORK ADSS LINE DESIGN

DRAWING TITLE

ADSS CABLE STORAGE BRACKET

DRAWING No.

SK-03

PROJECT No.

SHEET

REVISION

A2

FOR CLIENT REVIEW - BANDED OPTION, BOLT & DRAWING REFERENCE ADDED.

FOR CLIENT REVIEW

AMDT

AMENDMENT DETAIL

DESIGN	CHK'D	DRAWN	CHK'D	APP'D	DATE
KC	JD	KC	JD	07.2020	
KC	JD	KC	JD	05.2020	

PLOT DATE: May 06,2021 - 11:51am