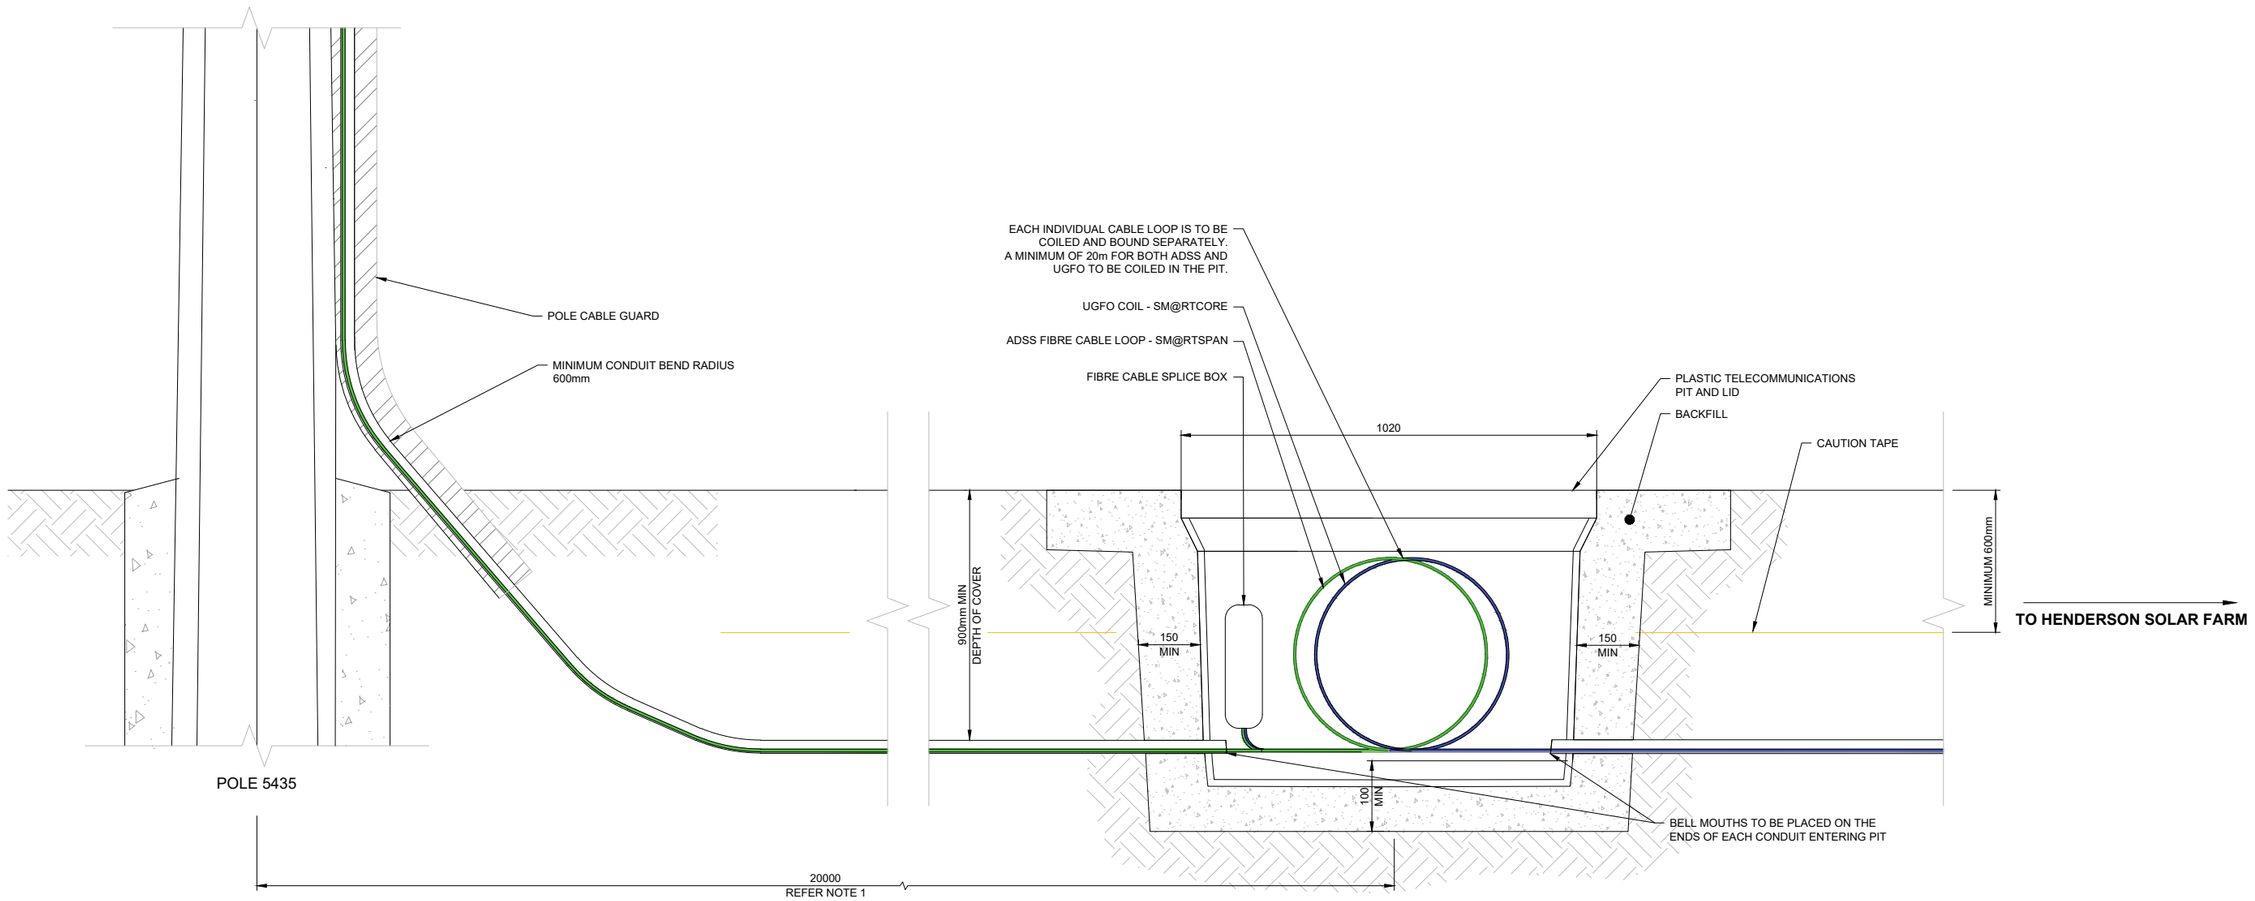

TELECOMMUNICATION PIT INSTALLATION DETAILS

NTS

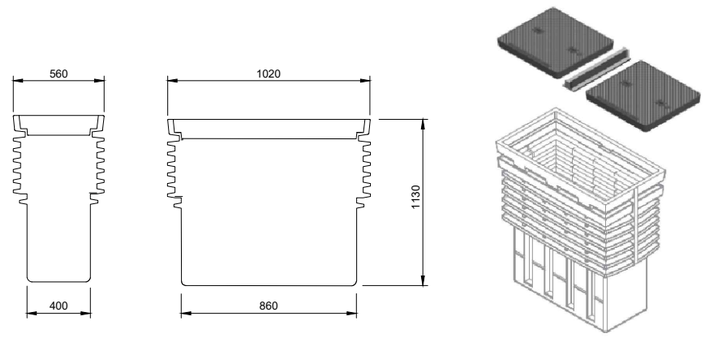

TELECOMMUNICATION PIT & LID DETAILS

NTS

REFERENCE DRAWINGS:
SK-08 UGOH TRANSITION POLE 5435 ADSS TERMINATION DETAILS
SK-09 ADSS UNDERGROUNDING ROUTE

NOTES:
1. TELECOMMUNICATION PIT TO BE IDEALLY LOCATED 20m AWAY FROM TRANSITION POLE 5435. IF NEED BE THIS DISTANCE CAN BE ADJUSTED TO SUIT ON SITE BUT CANNOT BE ANY FURTHER THAN 40m AWAY FROM TRANSITION POLE 5435.
2. REFER TO SK-08 FOR TRANSITION POLE 5435 ADSS TERMINATION ARRANGEMENT.
3. EXCAVATION FOR THE PIT SHOULD BE APPROXIMATELY 150mm GREATER THAN THE OUTER DIMENSIONS AROUND THE PIT WALLS, AND 100mm BELOW THE BASE.
4. ANY LARGE, SHARP OBJECTS OR OTHER PROTRUSIONS THAT MAY DAMAGE THE PIT MUST BE REMOVED PRIOR TO PLACEMENT OF THE PIT.

MATERIALS LIST		
TAG NO.	ITEM	QTY
1	PLASTIC TELECOMMUNICATIONS PIT	1
2	BLACK CAST IRON PIT COVER - LOCKABLE	1
3	COYOTE ONE DOME - SPLICE BOX	1
4	50mm COMMS BELL MOUTH	2

AMDT	AMENDMENT DETAIL	DESIGN	CHK'D	DRAWN	CHK'D	APP'DATE
A1	FOR CLIENT REVIEW	KC	JD	KC	JD	05.2020

CONTRACTOR

PLOT DATE: May 29,2020 - 3:56pm

SolomonPower
energising our nation

DESIGNED	KC	May 29,2020
CHECKED	JD	May 29,2020
DRAWN	KC	May 29,2020
CHECKED	JD	May 29,2020
APPROVED	IK	May 29,2020

A3 SCALE: NTS

PROJECT NAME: ADSS LINE DESIGN ON EXISTING 11kV LINE - EAST HONIARA

PROJECT DESCRIPTION: EASTERN NETWORK ADSS LINE DESIGN

DRAWING TITLE: TELECOMMUNICATIONS PIT DETAILS

DRAWING No.: SK-11

PROJECT No.:

SHEET:

REVISION: A1